

## Analysis of EPA's Proposed Carbon Rules One-Pager

Isaac Orr and Mitch Rolling, Center of the American Experiment

American Experiment modeled the resource adequacy, reliability, and cost of EPA's proposed Section 111 rules. We determined EPA's modeled MISO grid under the rules would not meet resource adequacy or reliability, and reliably meeting EPA's emissions targets would cost MISO ratepayers an additional \$246 billion compared to EPA's assumed grid.

### Resource (In)Adequacy

- EPA assumes massive changes to the MISO grid stemming from the Inflation Reduction Act (IRA). However, EPA did not conduct a resource adequacy or reliability analysis on this base case, it simply assumed the Post-IRA base case was adequate and reliable.
- **EPA's decision to narrowly tailor the resource adequacy analysis to only study the difference between the proposed rule and the Post-IRA base case is like studying the structural integrity of the top floor of a 100-story building without doing so for the preceding 99 floors.**
- EPA uses unrealistically high capacity values for wind (19% for existing 9-25% for new), solar (55% existing 55-32% for new), and 100% for battery and thermal resources.
- EPA's modeled MISO grid relies on wind, solar, and battery storage to meet projected peak demand and the target reserve margin, which is why EPA's modeled grid results in massive rolling blackouts.

### Reliability: EPA's Modeled Grid Results in Massive Rolling Blackouts

- EPA did not evaluate the reliability of its modeled MISO grid.
- American Experiment compared EPA's modeled power plant capacity portfolio to historical hourly electricity demand and hourly wind and solar capacity factors in 2019, 2020, 2021, and 2022 and determined EPA's modeled MISO grid would result in rolling blackouts in each of these Historical Comparison Years (HCY).
- One blackout event would be a 26 GW capacity shortfall in January 2040 using the 2021 HCY, representing 19.5 percent of the demand at the time of the capacity shortfall. This means one in every five homes would experience a rolling power outage in the region.
- **EPA's modeled generation mix cannot prevent blackouts while hindcasting observed historical conditions. Therefore, we should have no confidence in its assurances that it will have no impact on electric reliability in the future.**

### Cost: \$246 billion in additional costs for ratepayers compared to EPA's assumptions

- EPA's rules will result in \$246 billion in additional compliance costs in MISO, which is \$7.7 billion in annual compliance costs for the MISO region alone.
- This figure exceeds EPA's totaled modeled benefits of \$5.9 billion annually for the entire nation.

EPA is attempting to transform the entire U.S. electric grid using a process that is less rigorous and less transparent than a state integrated resource plan. More time and transparency is needed to thoroughly evaluate the impact of the proposed Section 111 rules in the entire country.

# REPORT DEVELOPED FOR NDIC / NDTA :

## Forecasting the Resource Adequacy, Reliability and Cost Impacts of EPA's 111 Rules Through 2055

### LONG *FORMAT PRESENTATION*


August 7, 2023

Isaac Orr and Mitch Rolling



# Executive Summary: EPA is Assuming Massive Changes to the MISO Grid Due to the IRA and Proposed Section 111 Rules

MISO ICAP: Current Grid vs. EPA's Modeled Generation Mix Under Proposed Section 111 Rules

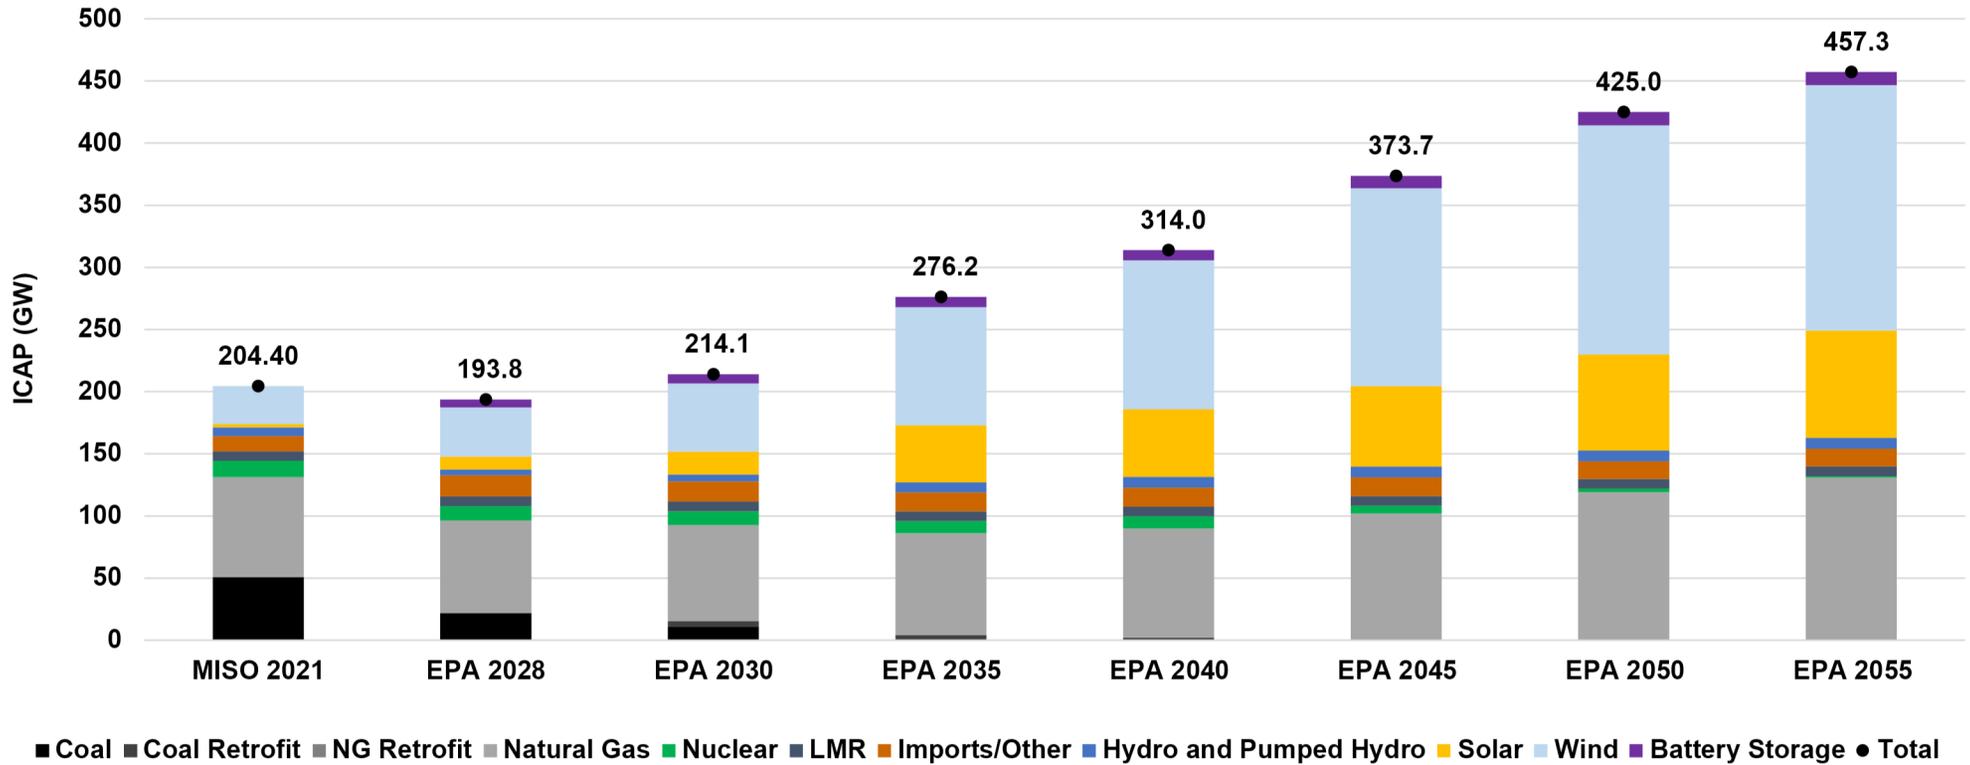

Data Source: Integrated Proposal with LNG Update



# Executive Summary: EPA's Modeled Grid Would Preserve Resource Adequacy Relative to the Base Case, But...

- EPA has narrowly defined the scope of the Regulatory Impact Analysis (RIA) of the regulations to maintain resource adequacy **compared to its Post-IRA base case.**
- EPA did not evaluate the resource adequacy or reliability of its Post-IRA base case, it simply assumed they are sufficient.


“The results presented in this document further demonstrate, for the specific cases illustrated in the Regulatory Impact Analysis (RIA), that the implementation of these rules can be achieved without undermining resource adequacy.”

“The focus of the analysis is on *comparing the illustrative proposed rules scenario from the RIA to a base case (absent the proposed requirements) that is assumed to be adequate and reliable.*” [emphasis added]

“In this framework, we emphasize the incremental changes in the power system that are projected to occur under the presence of the rules in the 2030, 2035 and 2040 model run years.”


# EPA Narrowly Tailors its Resource Adequacy Assessment

- EPA's decision to narrowly tailor the resource adequacy analysis to only study the difference between the proposed rule and the Post-IRA base case is like studying the structural integrity of the top floor of a 100-story building without doing so for the preceding 99 floors.

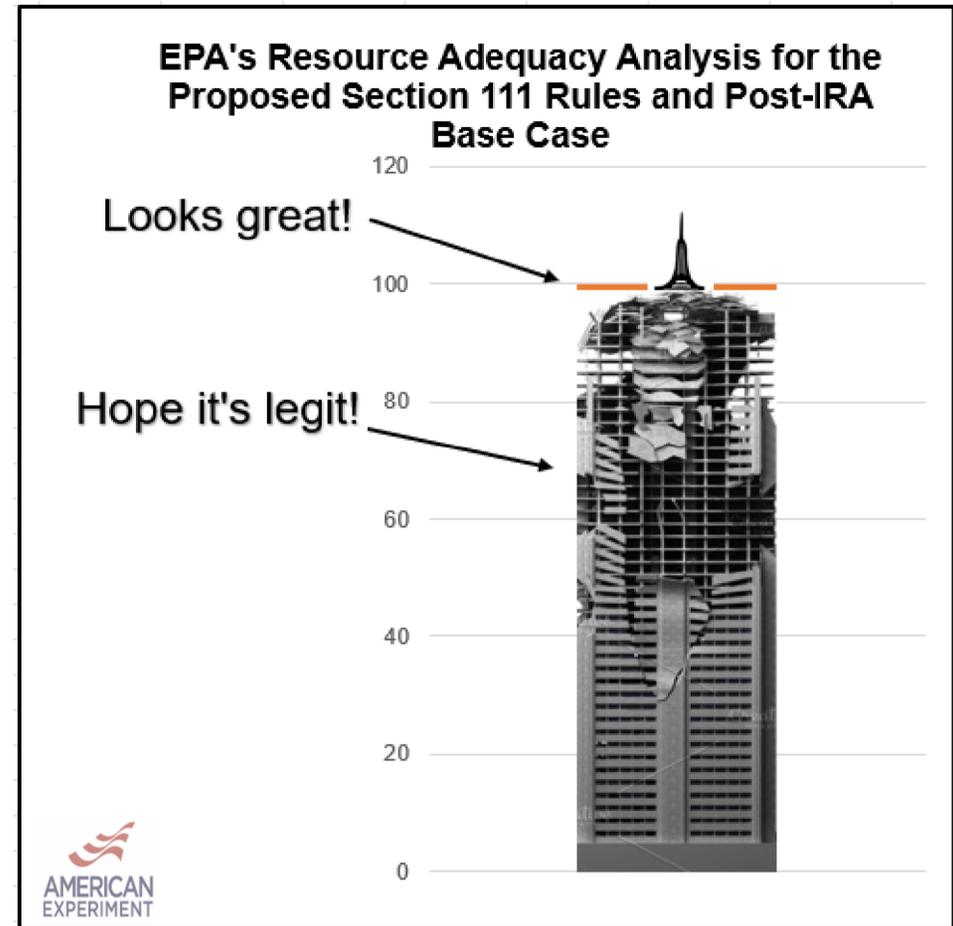


# Executive Summary: EPA's Modeled Grid Only Meets EPA's Reserve Margin With Generous Wind and Solar Capacity Accreditation and LMR/Import Assumptions

## MISO Current Grid vs. EPA Projected with EPA's Capacity Accreditation Assumptions

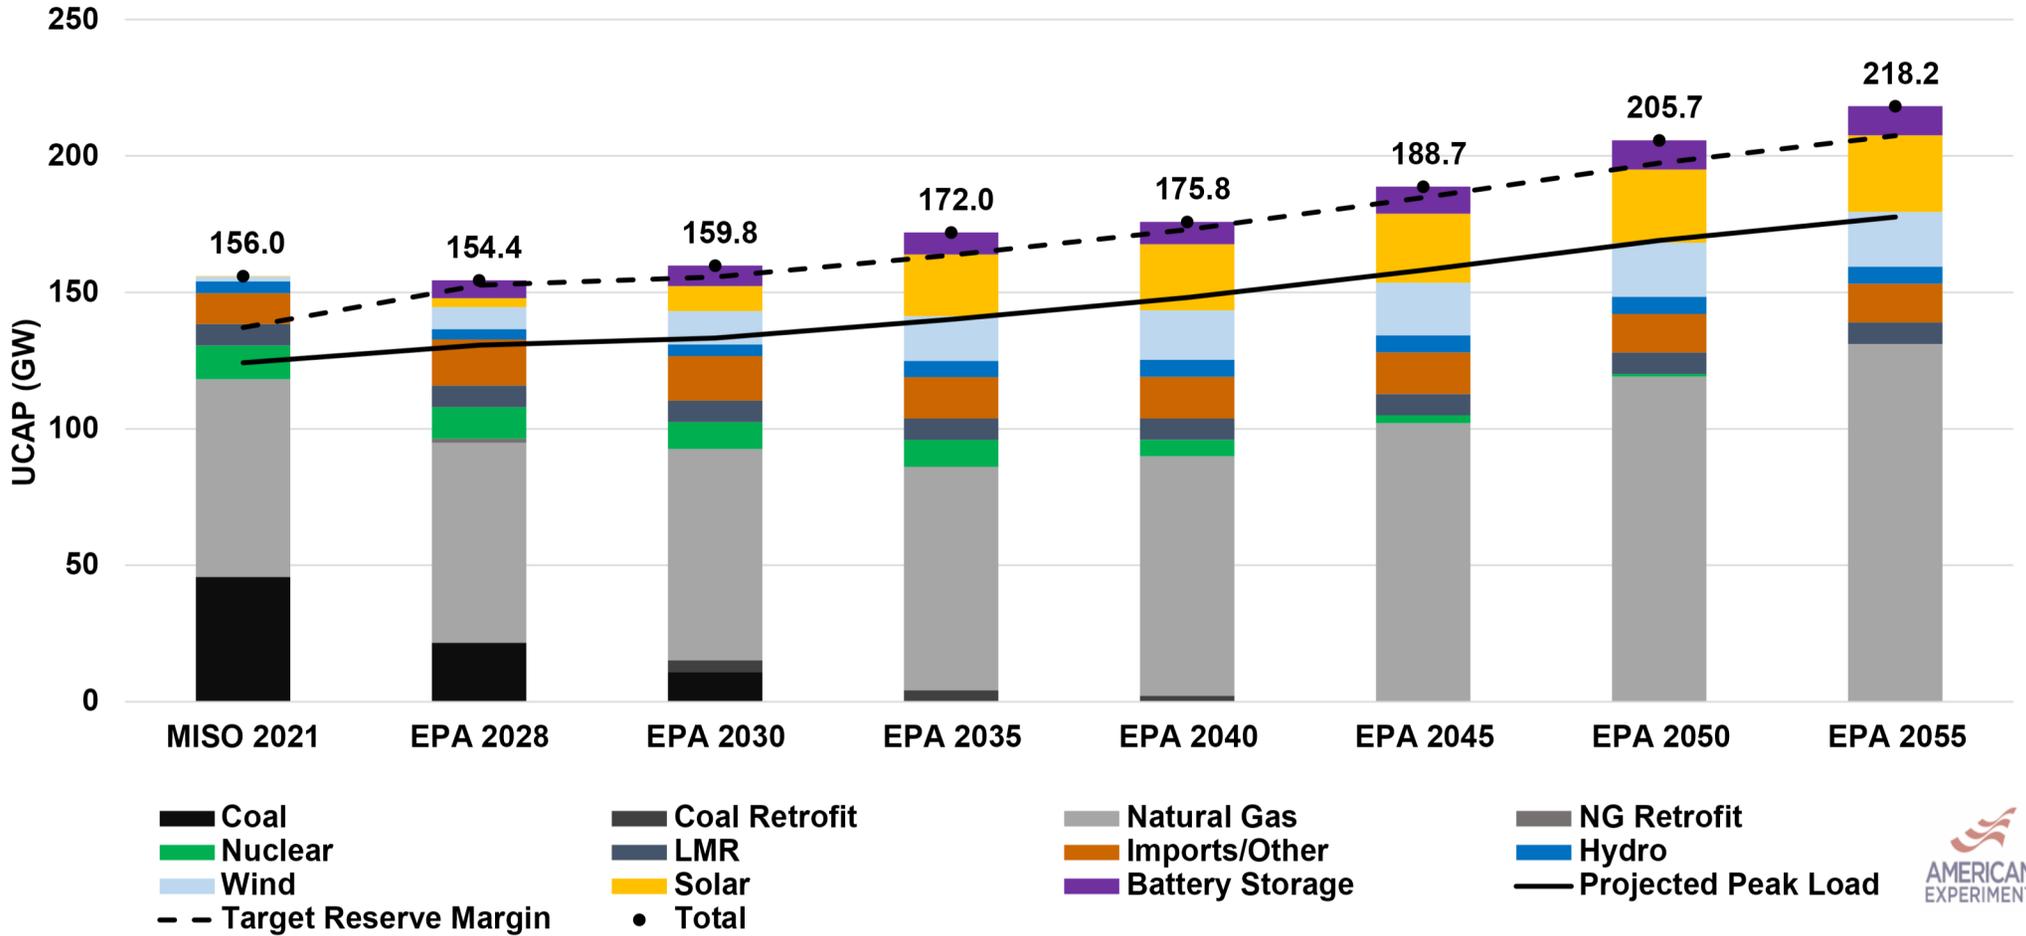


# Executive Summary: EPA's Modeled Grid Would Result in Blackouts

- EPA's modeled resource portfolio cannot keep the lights on.
- Our modeling found severe capacity shortfalls (rolling blackouts) in MISO when conducting hourly reliability assessments based on historic hourly electricity demand and hourly wind and solar capacity factors.

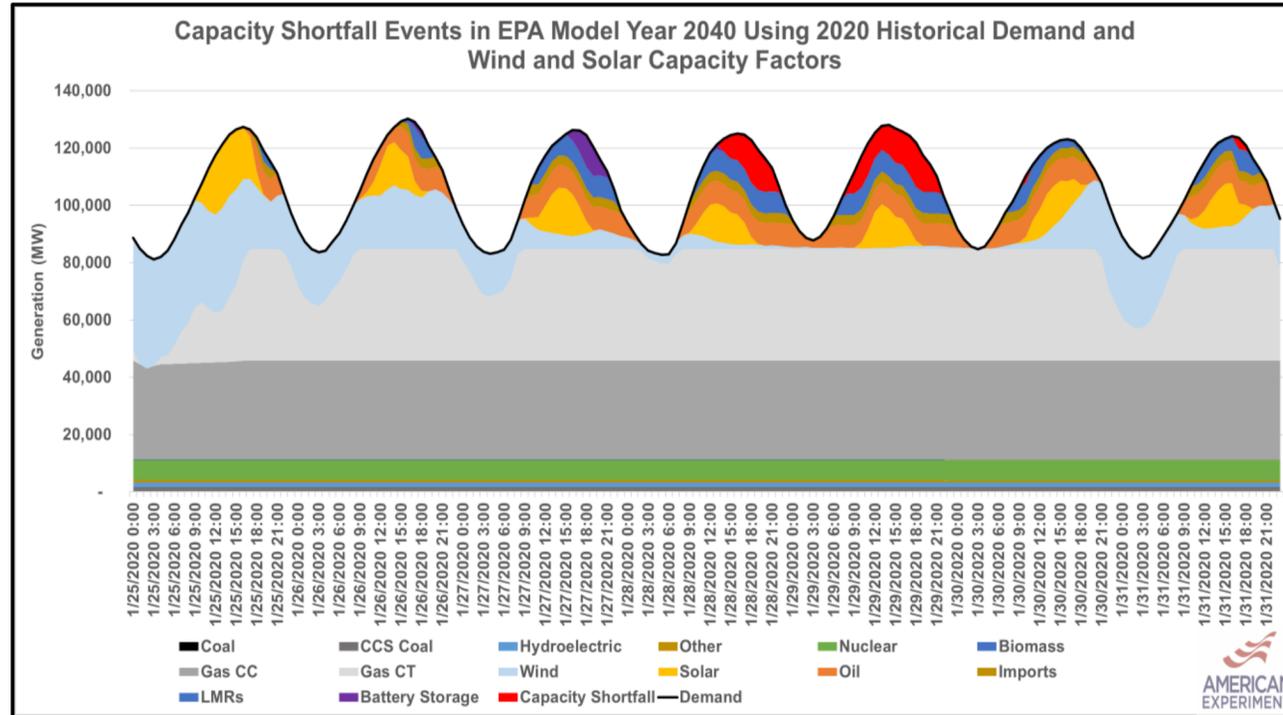


# Executive Summary: Meeting EPA's Modeled Emissions Targets While Maintaining Reliability Will Require A Significant Increase in Capacity Relative to EPA's Modeled Grid

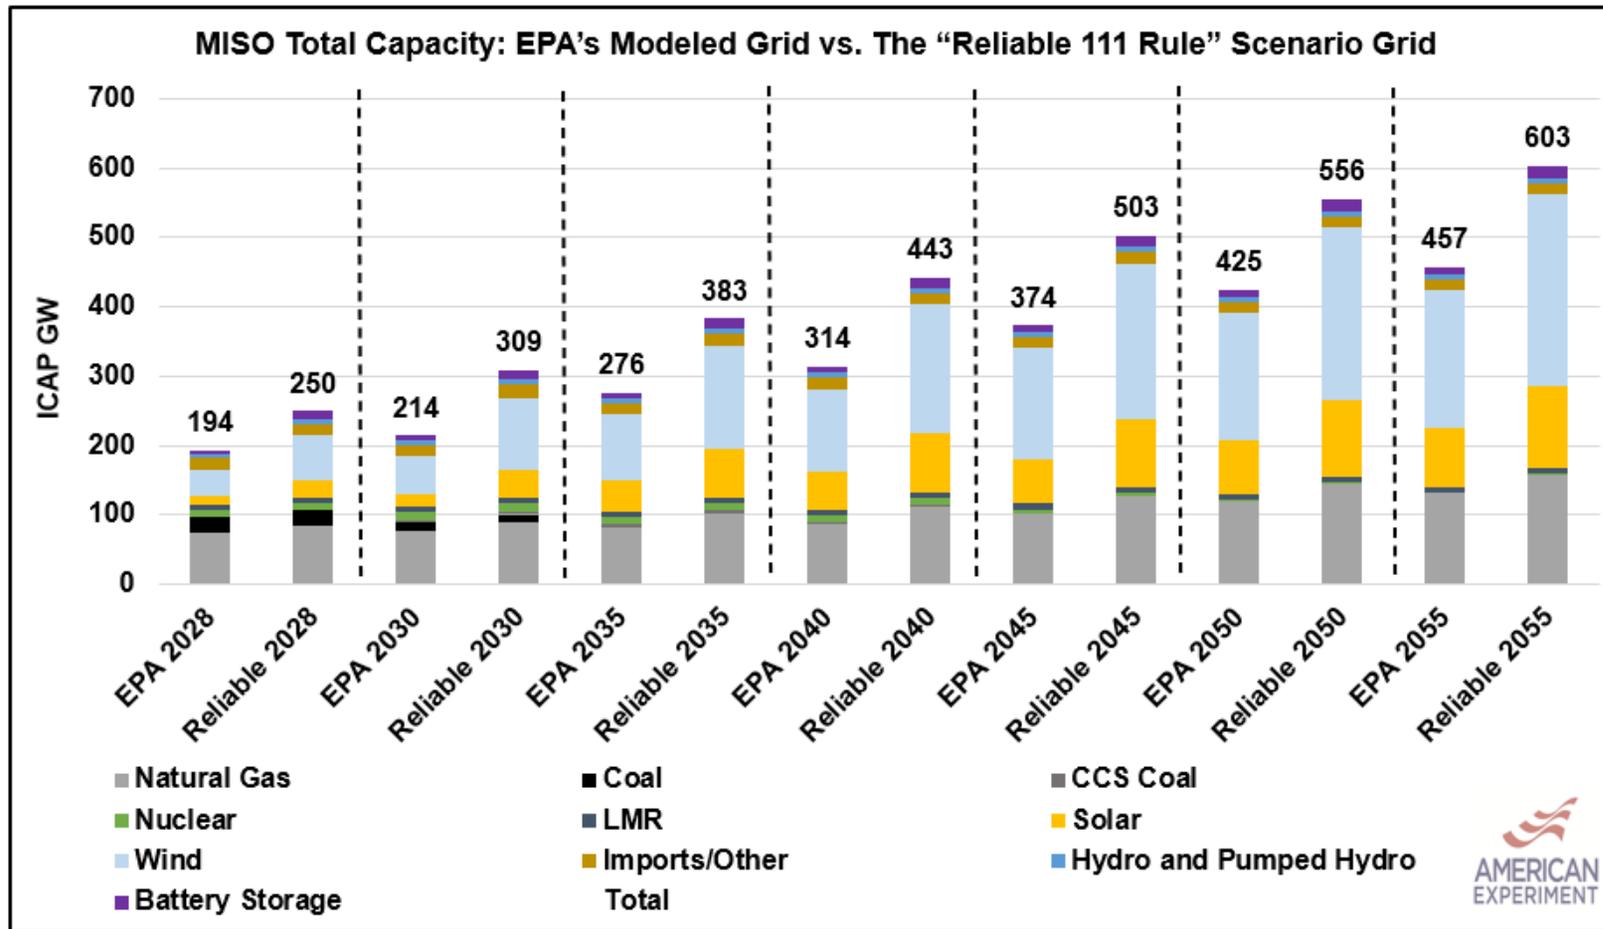

# Executive Summary: Shoring Up EPA's Modeled Grid Would Cost \$246 Billion

- Preventing capacity shortfalls while still meeting EPA's emission targets would require large capacity additions.
- These additions would increase the cost of compliance by \$246 billion through 2055, or \$7.7 billion annually, compared to the cost of EPA's modeled MISO grid in the Integrated Proposal with LNG Update.
- **This figure exceeds EPA's annual net benefit estimate of \$5.9 billion for the entire country.**

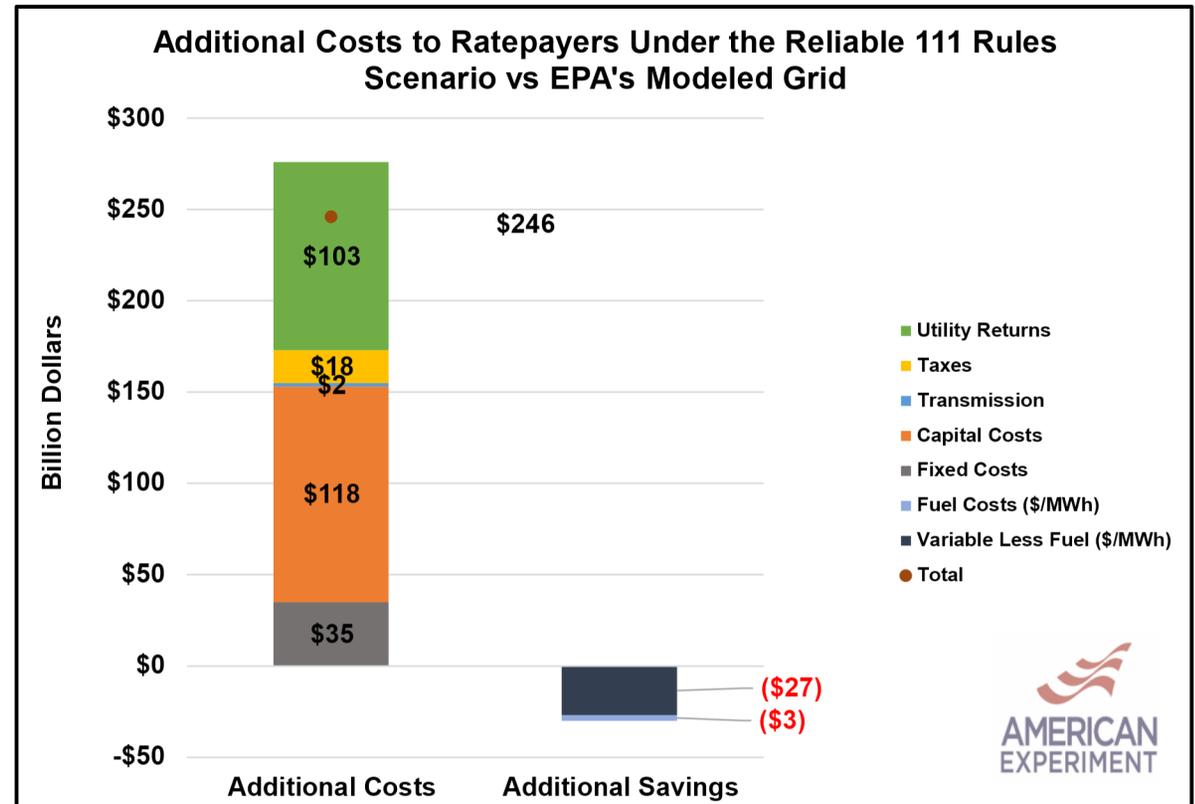

# Objectives: Model Resource Adequacy, Reliability, and Cost Under EPA's Proposed Section 111 Rules

## Step 1: Evaluate the Resource Adequacy (RA) of EPA's modeled generation fleet under its proposed 111 rules

- a. Determine if EPA's modeled grid meets its own RA/Reserve Margin requirements using EPA assumptions.
- b. Analyze EPA's accreditation methods used to predict RA metrics for all generating resources in the proposed Section 111 rules.

## Step 2: Evaluate the reliability of EPA's modeled generation portfolio under the new 111 rules

- a. Evaluate whether EPA's modeled portfolio can keep the lights on based on historical hourly electricity demand and wind and solar capacity factors.
- b. Historical MISO data for years 2019, 2020, 2021, and 2022 are used to "stress test" EPA's modeled grid.

## Step 3: Develop reasonable accreditation values for wind and solar

- a. 2019-2022 hourly dataset
  - i. Peak load availability
  - ii. Net peak load availability

## Step 4: Calculate the cost of meeting load every hour of the year while meeting EPA's emission targets in the "Reliable 111 Rules Scenario."

- a. Identify how much new capacity would be needed to maintain reliability and meet EPA emission targets.
- b. Use a Cost-of-Service retail electricity price model to calculate the cost of the regulations.

# Resource Adequacy

---

# EPA Narrowly Tailors its Resource Adequacy Assessment

“The results presented in this document further demonstrate, for the specific cases illustrated in the Regulatory Impact Analysis (RIA), that the implementation of these rules can be achieved without undermining resource adequacy.”

“The focus of the analysis is on *comparing the illustrative proposed rules scenario from the RIA to a base case (absent the proposed requirements) that is assumed to be adequate and reliable.*” [emphasis added]


“In this framework, we emphasize the incremental changes in the power system that are projected to occur under the presence of the rules in the 2030, 2035 and 2040 model run years.”

**Table 1. Operational Capacity Summary (2030, 2035, 2040)<sup>a</sup>**

| Capacity (GW)                    | 2030  | 2035  | 2040  |
|----------------------------------|-------|-------|-------|
| Base Case Operational Capacity   | 1,338 | 1,632 | 1,908 |
| Minus Retirements                |       |       |       |
| Coal                             | 0.4   | -22.2 | -17.0 |
| Oil/Gas                          | -0.5  | -0.3  | -0.3  |
| NGCC                             | -0.1  | 0.0   | 0.0   |
| NGCT                             | -0.3  | -0.2  | -0.2  |
| Nuclear                          | 0.0   | 0.0   | 0.0   |
| Plus Additions                   |       |       |       |
| NGCC                             | 3.5   | 1.0   | 1.1   |
| NGCT                             | 0.3   | 23.1  | 18.2  |
| Wind                             | 0.4   | 2.0   | -0.2  |
| Solar                            | 0.7   | 0.4   | -1.0  |
| Storage                          | -0.1  | -2.2  | -2.1  |
| Other                            | 0.0   | 0.0   | 0.0   |
| Policy Case Operational Capacity | 1,342 | 1,633 | 1,906 |


# EPA Narrowly Tailors its Resource Adequacy Assessment

- EPA's decision to narrowly tailor the resource adequacy analysis to only study the difference between the proposed rule and the Post-IRA base case is like studying the structural integrity of the top floor of a 100-story building without doing so for the preceding 99 floors.

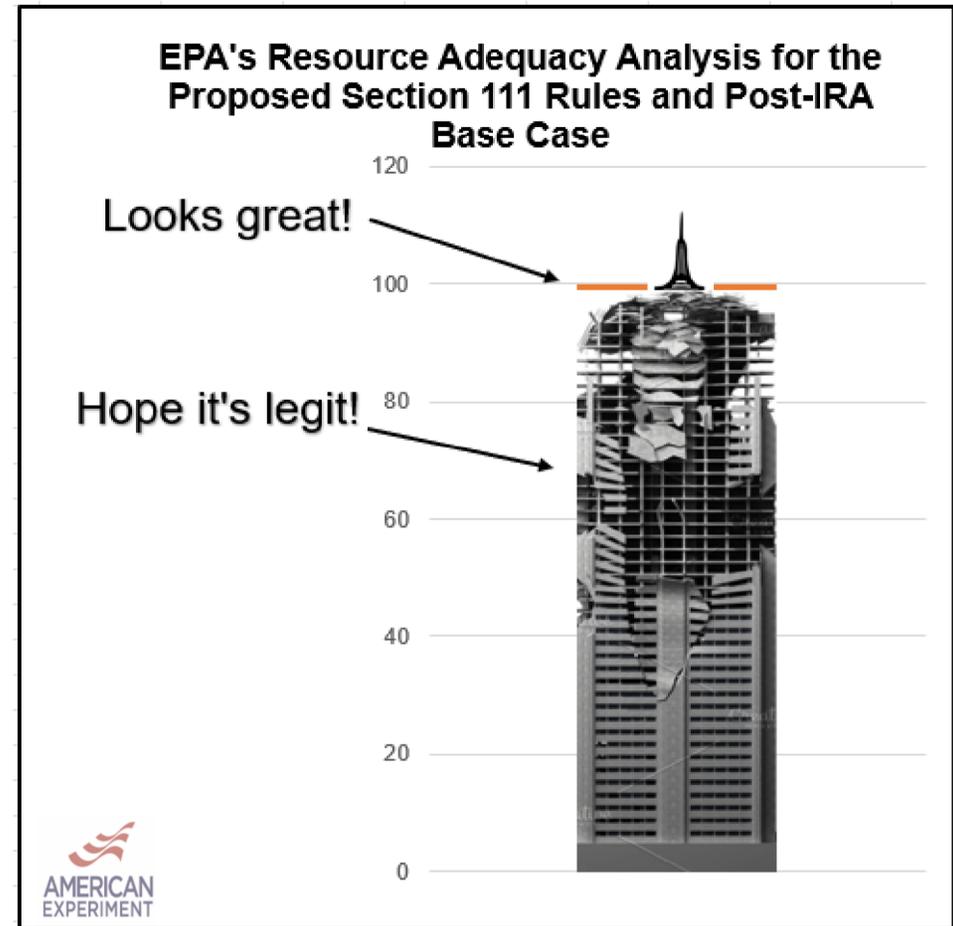

# Why Do We Care About MISO Resource Adequacy?


- MISO resource adequacy is challenged by a changing energy mix.
  - MISO had a 1,200 MW capacity shortfall from the Planning Reserve Margin (PRM) in the summer of 2022.
- Planned retirements and additions show a continued decline in thermal generation and an increase in weather-dependent renewables.
- Given these trends, there is critical need to assess short term reliability risks to the MISO region.

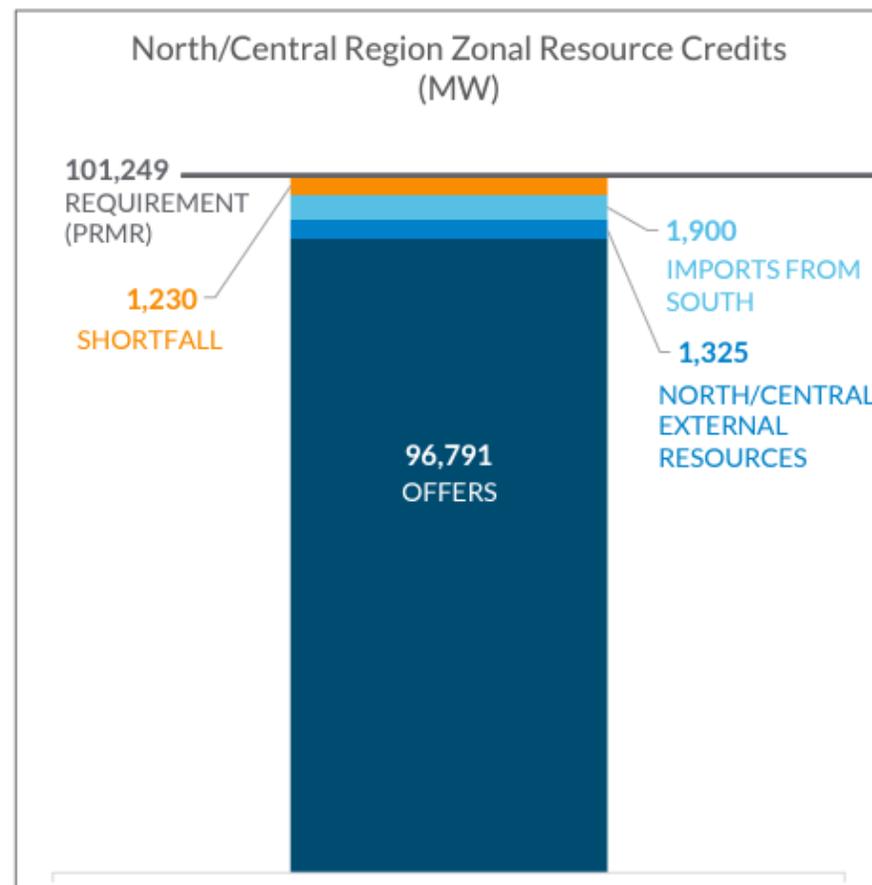

# More Total Capacity, Less Accredited Capacity

- The total amount of installed nameplate capacity (ICAP) on the MISO system continues to grow, but the accredited capacity (UCAP) has fallen as a result of coal and some nuclear retirements.
- Source: [MISO 2022/2023 Planning Resource Auction \(PRA\) Results](#)


Although installed capacity has increased in the last five years, accredited capacity has decreased due to thermal retirements and the increasing transition to renewables

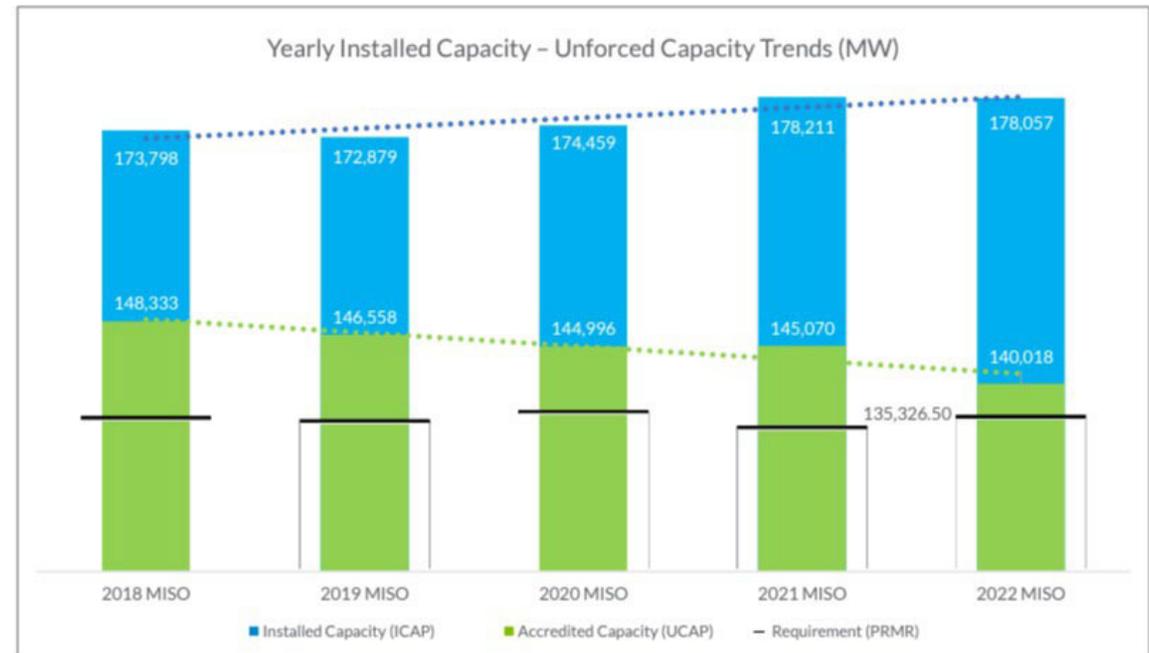

# MISO Projects Future Capacity Shortages

- MISO/OMS survey projects a 1,500 MW surplus for Planning Year 2024-2025 because coal retirements have been delayed.
- Without continuation of such actions, a capacity deficit of 2,100 MW is projected for the summer of 2025/26 which grows in subsequent years.
- By PY28/29, MISO could have a 9.5 GW capacity shortfall.
- Source: [2023 OMS/MISO Survey Results](#).

Committed Capacity shows declines over survey window with potential resource deficits starting in PY 2025/26

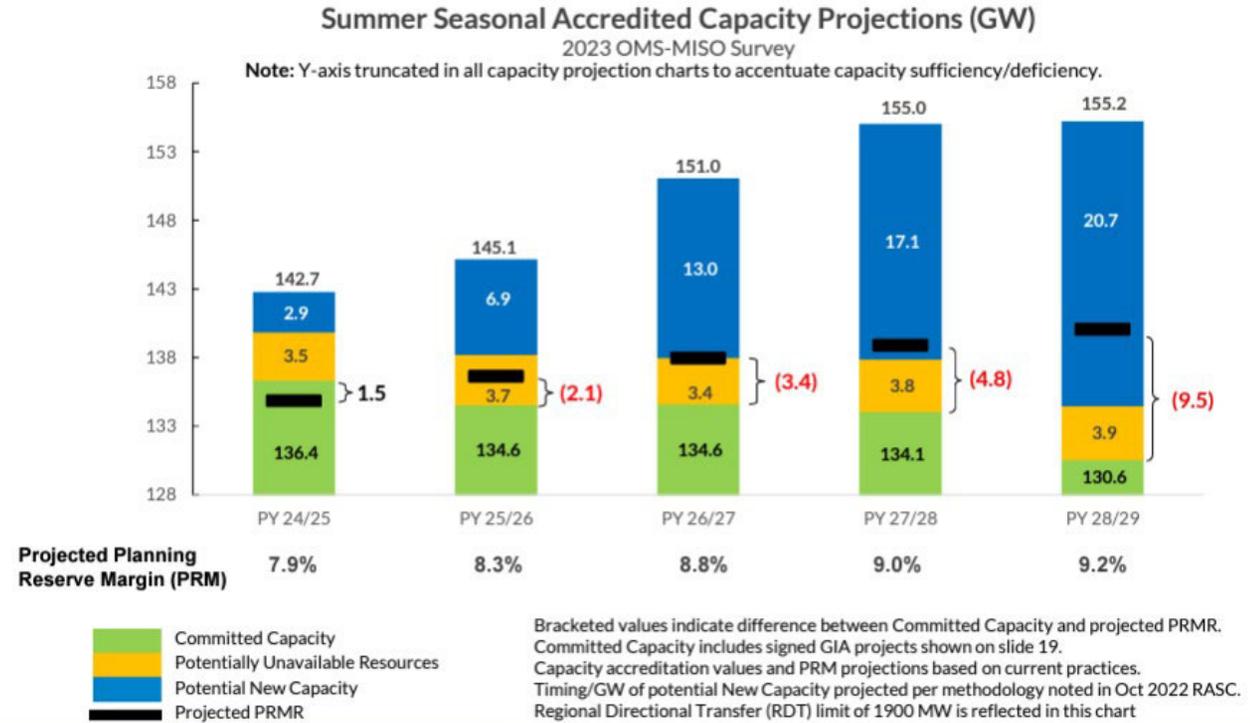


# MISO's Current UCAP Capacity Mix

- MISO's current UCAP mix is largely natural gas, coal, nuclear, and demand response with wind and solar constituting 8 percent of the UCAP.
- UCAP is based on MISO's cleared capacity at auction, which is capacity that MISO can reliably call upon and is less than total installed capacity on MISO's grid.
- This mix will change rapidly moving forward due to state policies, utility decisions, IRA subsidies, and the proposed Section 111 rules.

| Resources       | GW | Percent UCAP |
|-----------------|----|--------------|
| Coal            | 37 | 28%          |
| Gas             | 56 | 42%          |
| Nuclear         | 11 | 9%           |
| Demand Response | 8  | 6%           |
| Hydroelectric   | 7  | 5%           |
| Oil             | 4  | 3%           |
| Wind            | 5  | 4%           |
| Solar           | 3  | 2%           |
| Misc.           | 2  | 2%           |


# MISO Sees Growing Solar and Wind in Capacity Stack, But It Is Still Counting on Significant MW of Coal Through 2031

MISO Fleet UCAP Resource Mix Projection

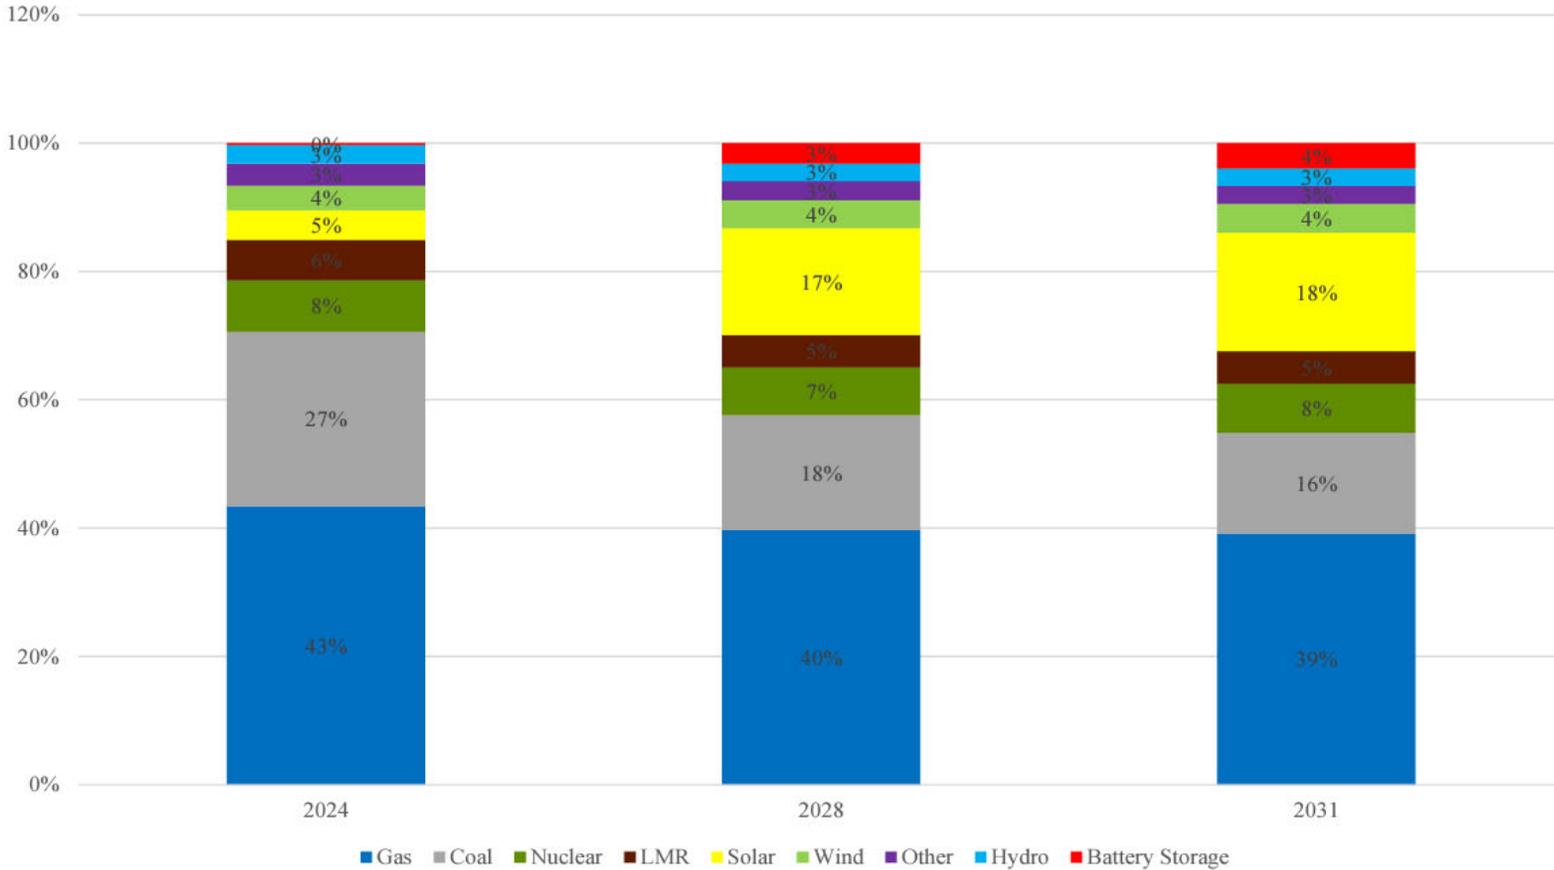


# MISO's Accreditation Methods and "Phantom Firm" Resources

- The previous slides may **overstate** the amount of UCAP that will be on the system due to MISO's capacity accreditation method for wind and solar.
- Wind is assumed to produce 18.1% of potential output during summer peak hours and new solar was expected to produce 50% for the first year in operation.
- However, wind and solar routinely underperform accreditation causing "Phantom Firm" resources to potentially enter into capacity auctions and the PRM capacity stack.
- This could give grid operators a false sense of security when it comes to reliability.

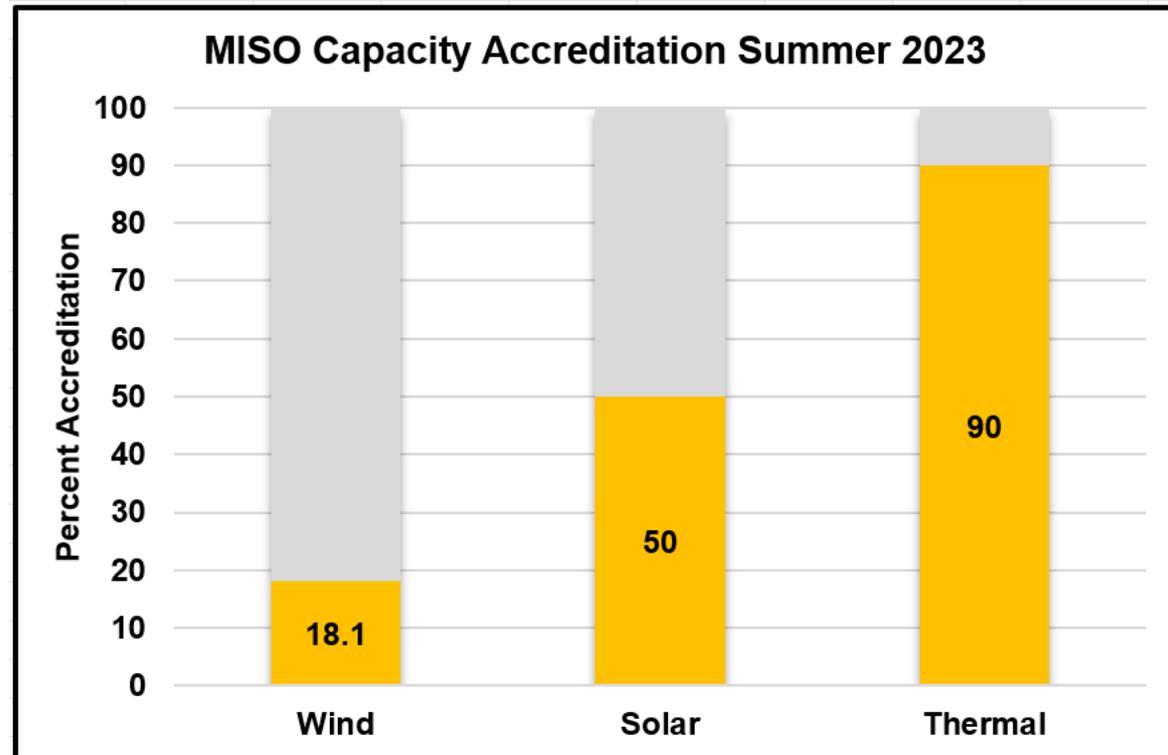

# UCAP Underperformance is Not Uncommon

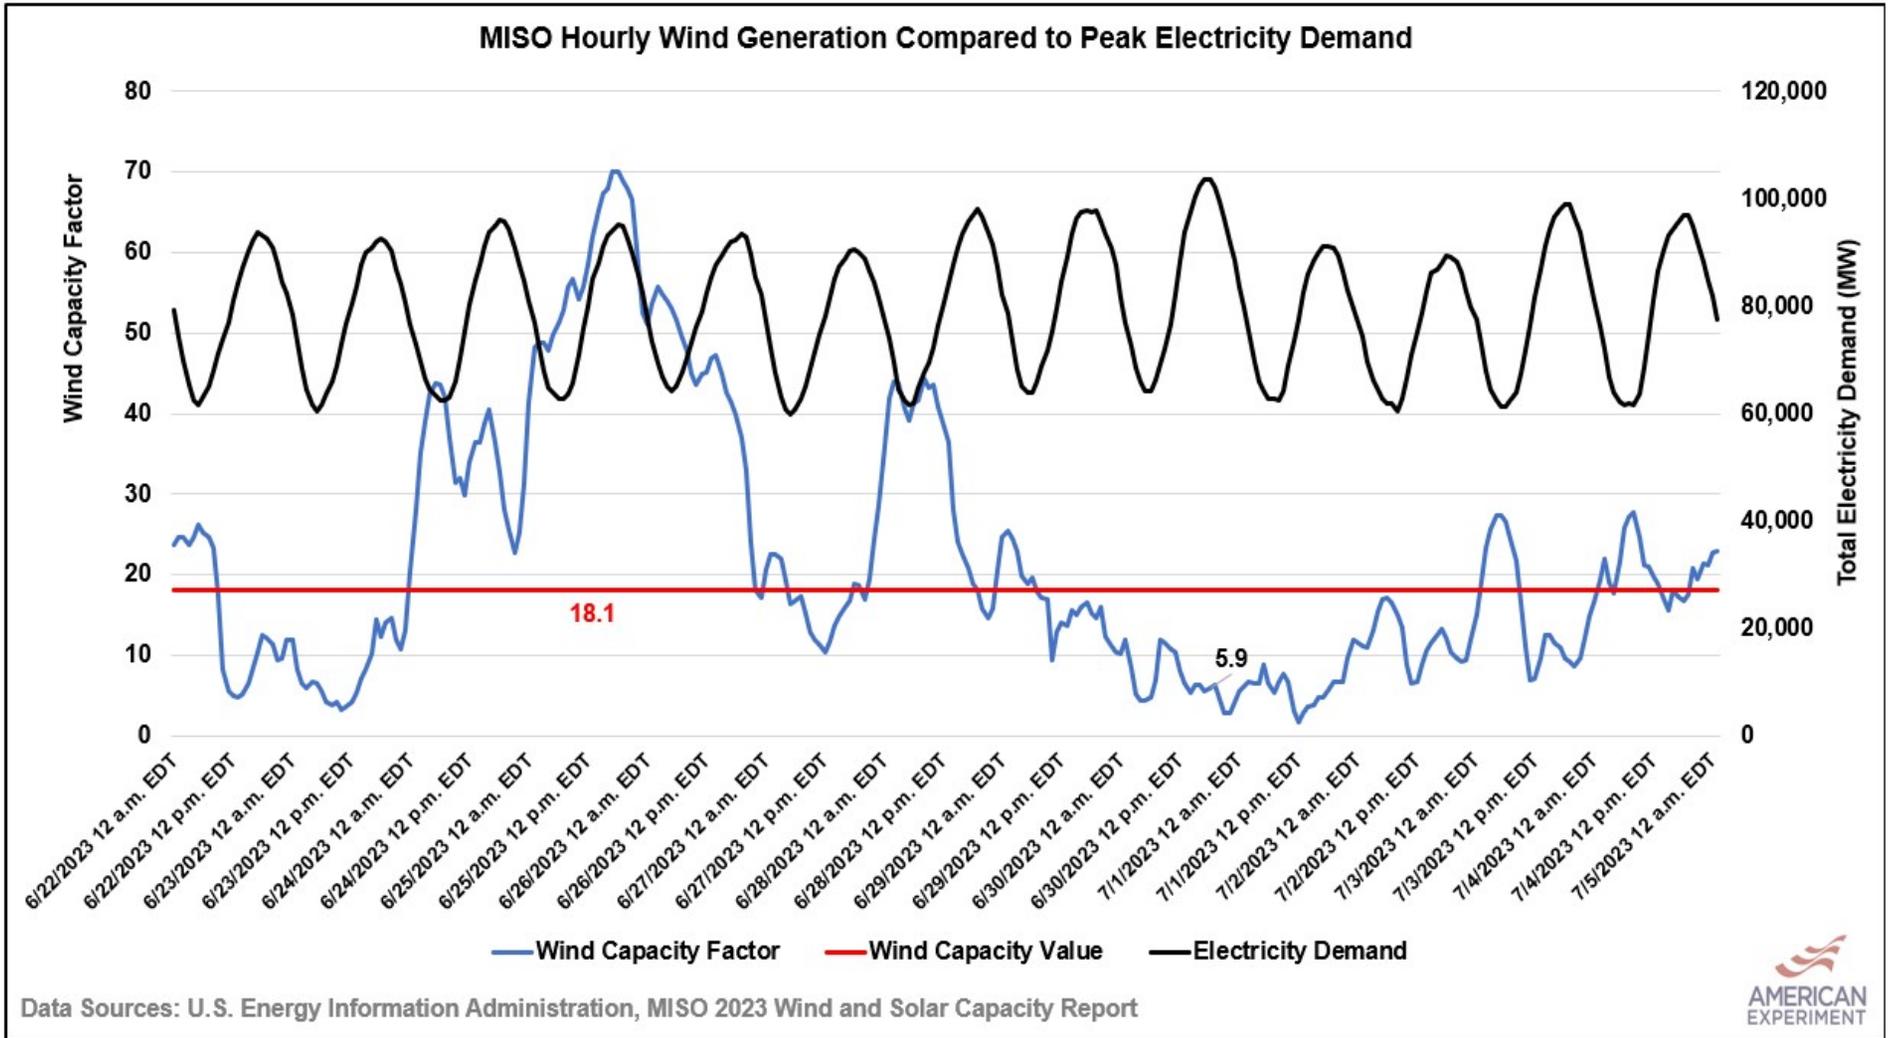


# Resource Accreditation Under EPA's Proposal

- According to the Resource Adequacy Technical Support Document, EPA's Integrated Planning Model (IPM) selects resources using a target reserve margin in each region as the basis for determining how much accredited capacity (UCAP) to keep operational (or build) to preserve resource adequacy.
- Capacity accreditation is assumed to be 100 percent for thermal resources, and variable technologies (primarily wind and solar) receive region-specific capacity credits to help meet target reserve margin constraints. Due to their variability, resources such as wind and solar received a derate relative to the nameplate capacity when solving for reserve margin.
- EPA has **NOT** conducted a resource adequacy or reliability analysis on its Post-IRA base case, which is a large oversight.


| EPA's Proposed 111 Regulations |                                      |
|--------------------------------|--------------------------------------|
| Resource                       | EPA's Capacity Accreditation in MISO |
| Existing Onshore Wind          | 19%                                  |
| Existing Solar                 | 55%                                  |
| New Onshore Wind               | 9%-25%                               |
| New Solar                      | 32%-52%                              |
| Existing Thermal               | 100%                                 |
| Existing Hydro                 | 56%                                  |
| New Hydro                      | 65%                                  |
| Existing Energy Storage        | 48%                                  |
| Pumped Storage                 | 95%                                  |
| New Battery Storage            | 100%                                 |

# EPA's Yearly Capacity Values

- EPA assumes thermal resources maintain a constant 100% accreditation throughout the model run.
- Existing wind and solar resources maintain a constant accreditation of 19% and 55%, respectively.
- New wind and solar resources experience declining capacity values as the penetration of intermittent resources increases over time.

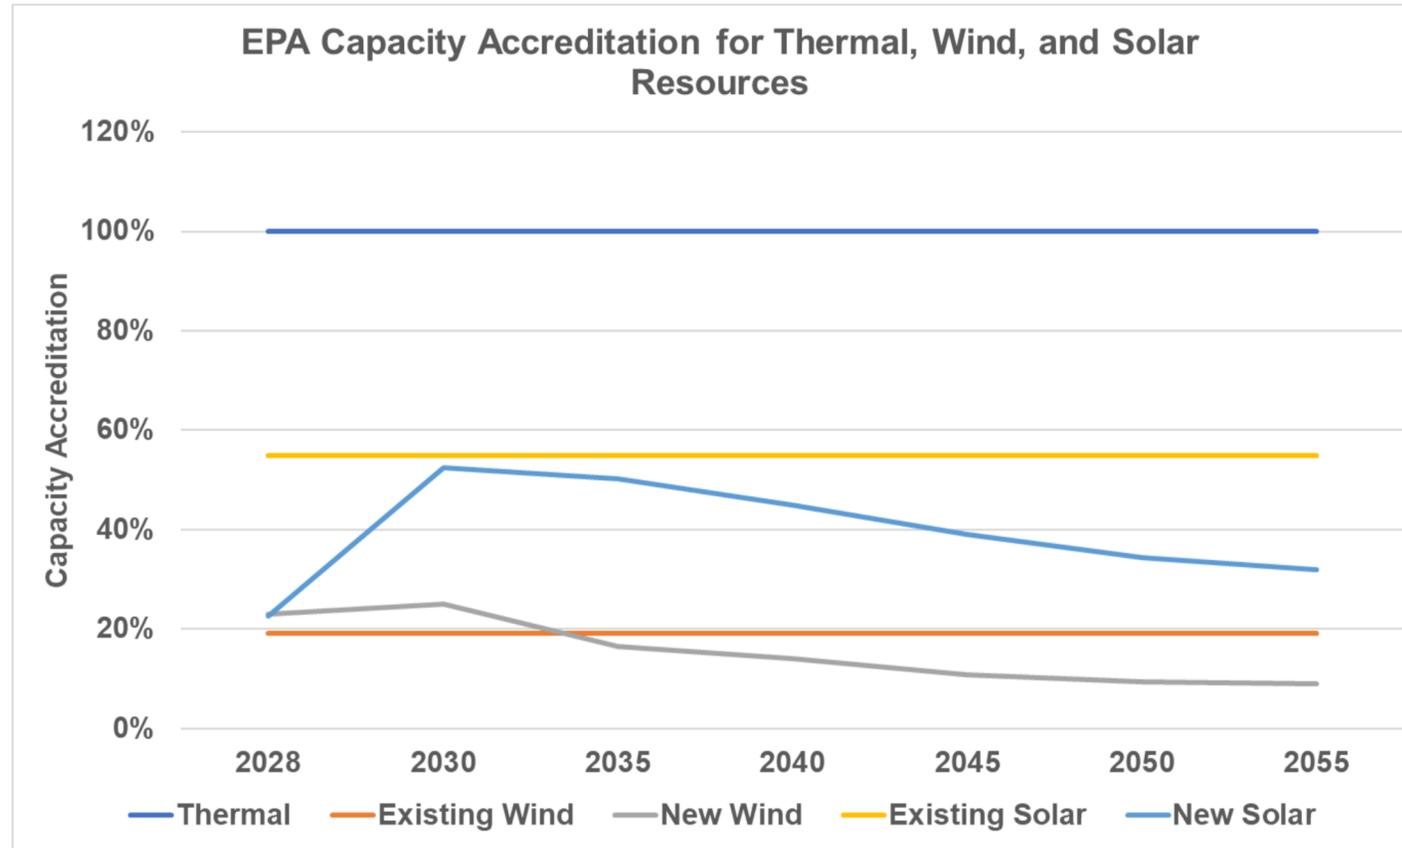

# EPA's Modeled Portfolio in MISO Under the Proposed 111 Rules Relies on Wind, Solar, and Storage to Peak Demand and Reserve Margins

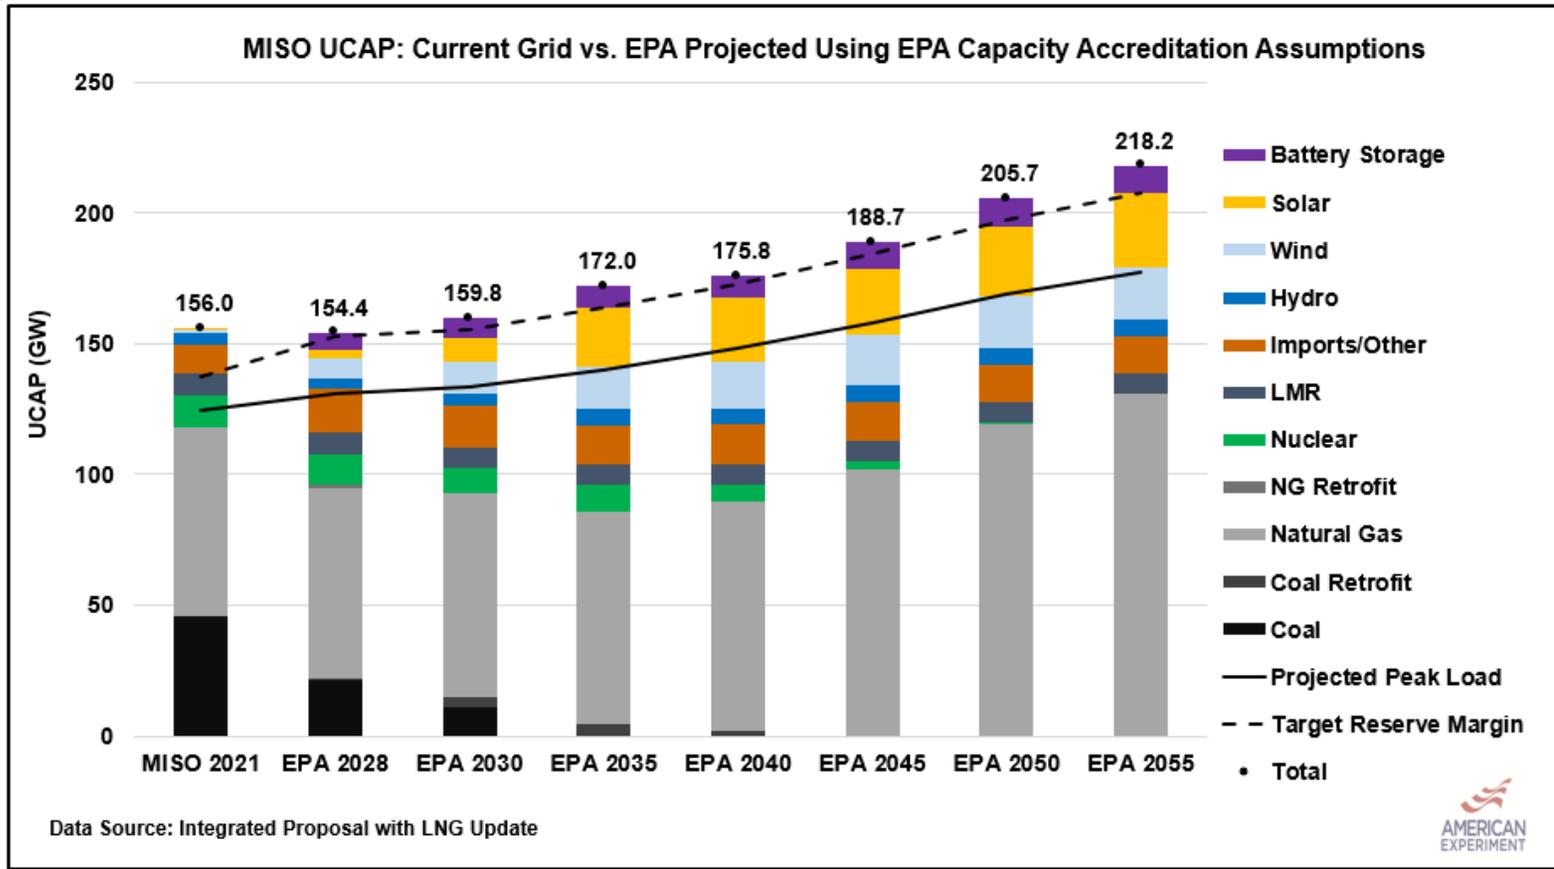

| Year        | Reserve Margin |
|-------------|----------------|
| 2022        | 25.6%          |
| <b>2028</b> | <b>18.2%</b>   |
| <b>2030</b> | <b>19.9%</b>   |
| <b>2035</b> | <b>22.2%</b>   |
| <b>2040</b> | <b>18.7%</b>   |
| <b>2045</b> | <b>19.3%</b>   |
| <b>2050</b> | <b>21.7%</b>   |
| <b>2055</b> | <b>22.9%</b>   |

Estimated firm capacity using EPA's accreditation values for wind, solar, storage (100%), and thermal resources (100%). EPA assumes a 16.8 percent reserve margin. Different than MISO cleared UCAP (unforced [accredited] capacity). Red indicates intermittent generation is necessary to meet Target Reserve Margins.

# Resource Adequacy Takeaways

- EPA relies on wind, solar, and battery storage to meet its peak demand and target reserve margin in 2028.
- From 2030 and beyond, EPA relies on wind, solar, and battery storage to meet peak electricity demand.
- This **will result in rolling blackouts** if wind and solar are not performing at their capacity accreditation metrics.



# Reliability


---

# EPA Distinguishes Between Resource Adequacy and Reliability

- EPA distinguishes between resource adequacy and reliability in its Resource Adequacy Technical Support Document:
  - “As used here, the term **resource adequacy** is defined as the provision of adequate generating resources to meet projected load and generating reserve requirements in each power region, while **reliability** includes the ability to deliver the resources to the loads, such that the overall power grid remains stable.” [emphasis added].
  - “**This document is meant to serve as a resource adequacy assessment** of the impacts of the final rule and how projected outcomes under the final rule **compare with projected baseline outcomes in the presence of the IRA.**” [emphasis added].
- EPA’s definition of reliability is critically important because the deliverability of electricity was not analyzed by the agency in its modeling. EPA goes on to say that “resource adequacy ... is necessary (but not sufficient) for grid reliability.”

# Reliability Under EPA's Proposal

- Resource Adequacy and reserve margin analyses can be useful tools for determining resource adequacy and reliability, but **the shift away from dispatchable thermal resources toward intermittent wind and solar generators increases the complexity and uncertainty in these analyses** and makes them increasingly dependent on the quality of the assumptions used to construct capacity accreditations.
- As the grid becomes more reliant upon variable generators, it is crucial to “stress test” the assumptions used to create capacity accreditations by performing an hourly reliability analysis that accounts for fluctuations in electricity demand, and hourly variation in wind and solar capacity factors.
- EPA has **NOT** conducted a reliability analysis on its modeled grid to stress test their post IRA-Base Case assumptions.

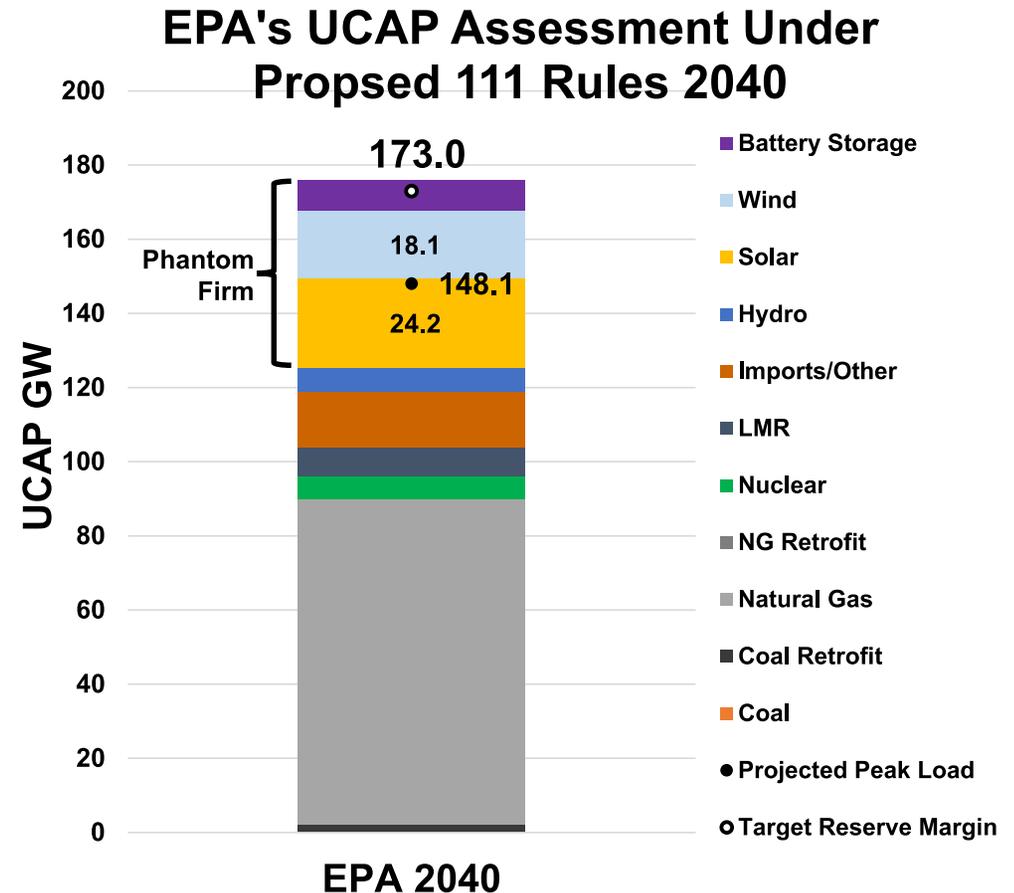

# Assessing Reliability Under EPA's Proposal

- American Experiment conducted a reliability analysis on EPA's modeled generation portfolio in the MISO region under the proposed Section 111 rules by using EPA's installed capacity assumptions from the Integrated Proposal with LNG Update.
- The analysis was conducted by comparing EPA's modeled generation portfolio to the historical hourly electricity demand and hourly capacity factors for wind and solar in 2019, 2020, 2021, and 2022 to assess whether the installed resources would be able to serve load for all hours in each Historic Comparison Year (HCY).
- Hourly demand and wind and solar capacity factors were adjusted upward to meet EPA's peak load, annual generation, and capacity factor assumptions.
  - This assumption is generous to EPA because it increases the annual output of wind and solar generators to levels that are not generally observed in MISO.
  - Additionally, other policies pursued by the EPA may increase peak load even further, but this additional load was not studied in this analysis.
- Will EPA's modeled grid be able to meet demand based on these observed, real-life model inputs?



# Assessing Reliability Under EPA's Proposal

- EPA's modeled MISO grid cannot keep the lights on.
- Our model observed a total of 607 hours of capacity shortfalls in the modeled years.
- In no year that EPA modeled was the modeled grid able to maintain reliability for the entirety of the four years of historical data used.

| Historical Comparison Year | Number of Hours of Capacity Shortfalls (Total Hours of Blackouts) |      |      |      |      |      |      |
|----------------------------|---|------|------|------|------|------|------|
|                            | 2028  | 2030 | 2035 | 2040 | 2045 | 2050 | 2055 |
| 2019                       | 12  | 43   | 70   | 79   | 40   | 22   | 8    |
| 2020                       | 0   | 0    | 20   | 29   | 21   | 15   | 7    |
| 2021                       | 14  | 24   | 37   | 40   | 30   | 22   | 16   |
| 2022                       | 9   | 18   | 15   | 16   | 0    | 0    | 0    |

# Assessing Total Blackout Hours in EPA's Modeled Proposal

- EPA's modeled grids experienced over 7 million megawatt hours (MWh) of shortfalls in the EPA modeled years.
- For example, our analysis found EPA's modeled grid would result in over 1.4 million MWhs of shortfalls using 2019 historical data and EPA modeled capacity in 2040.

| Historical Comparison Year | Megawatt Hours of Unserved Load |         |         |           |         |         |         |
|----------------------------|---------------------------------|---------|---------|-----------|---------|---------|---------|
|                            | 2028                            | 2030    | 2035    | 2040      | 2045    | 2050    | 2055    |
| 2019                       | 56,235                          | 201,102 | 507,873 | 1,488,223 | 890,790 | 519,640 | 314,825 |
| 2020                       | 0                               | 0       | 131,763 | 234,407   | 167,052 | 89,840  | 37,191  |
| 2021                       | 92,736                          | 205,888 | 450,108 | 526,546   | 394,755 | 283,706 | 210,027 |
| 2022                       | 20,216                          | 73,362  | 65,507  | 74,128    | 0       | 0       | 0       |

# Assessing the Social Cost of Blackouts

- Using the modeled hours of capacity shortfalls, American Experiment calculated the “Social Cost of Blackouts,” based on the theory of Value of Lost Load (VoLL). We estimated capacity shortfalls cost \$14,250 per MWh.
- For example, our analysis found EPA’s modeled grid would result in \$57 billion in blackout costs in the seven model years examined using 2019 hourly electricity demand, and hourly wind and solar capacity factors.

| Historical Comparison Year | Value of Lost Load |                 |                 |                  |                  |                 |                 |                  |
|----------------------------|--------------------|-----------------|-----------------|------------------|------------------|-----------------|-----------------|------------------|
|                            | 2028               | 2030            | 2035            | 2040             | 2045             | 2050            | 2055            | Total            |
| 2019                       | \$801,348,750      | \$2,865,703,500 | \$7,237,190,250 | \$21,207,177,750 | \$12,693,757,500 | \$7,404,870,000 | \$4,486,256,250 | \$56,696,304,000 |
| 2020                       | \$0                | \$0             | \$1,877,622,750 | \$3,340,299,750  | \$2,380,491,000  | \$1,280,220,000 | \$529,971,750   | \$9,408,605,250  |
| 2021                       | \$1,321,488,000    | \$2,933,904,000 | \$6,414,039,000 | \$7,503,280,500  | \$5,625,258,750  | \$4,042,810,500 | \$2,992,884,750 | \$30,833,665,500 |
| 2022                       | \$288,078,000      | \$1,045,408,500 | \$933,474,750   | \$1,056,324,000  | \$0              | \$0             | \$0             | \$3,323,285,250  |

# Assessing the Duration of Blackouts Under EPA's Proposal

- EPA modeled capacity would result in a 9 to 15 hour blackout event in each of the modeled years, depending on the historical year studied.
- For example, our analysis found EPA's modeled grid would result in a multiple 15-hour shortfall events in 2040 and multiple 14- hour shortfall events in 2035, 2040, 2045, and 2050.

| Historical Comparison Year | Longest Duration Blackout (Hours) |      |      |      |      |      |      |
|----------------------------|-----------------------------------|------|------|------|------|------|------|
|                            | 2028                              | 2030 | 2035 | 2040 | 2045 | 2050 | 2055 |
| 2019                       | 9                                 | 11   | 14   | 15   | 14   | 14   | 13   |
| 2020                       | 0                                 | 0    | 13   | 14   | 14   | 13   | 7    |
| 2021                       | 9                                 | 11   | 14   | 15   | 14   | 14   | 13   |
| 2022                       | 7                                 | 8    | 4    | 4    | 0    | 0    | 0    |


# Assessing Severity of the Blackouts

- Our model observed a maximum shortfall event of anywhere from 9,200 to 26,350 MW in each of the modeled years using EPA modeled capacity.
- For example, our analysis found EPA's modeled grid would result in a shortfall of over 26 GW in 2040 and 2045 using 2021 historical data, which is 17.5% of EPA's projected peak load in 2040.

| Historical Comparison Year | Severity of Worst Blackout (MW) |        |        |        |        |        |        |
|----------------------------|---------------------------------|--------|--------|--------|--------|--------|--------|
|                            | 2028                            | 2030   | 2035   | 2040   | 2045   | 2050   | 2055   |
| 2019                       | 7,966                           | 12,330 | 20,253 | 24,273 | 23,730 | 22,382 | 20,956 |
| 2020                       | 0                               | 0      | 11,261 | 15,279 | 14,959 | 13,130 | 11,185 |
| 2021                       | 9,204                           | 13,444 | 21,976 | 26,351 | 26,147 | 24,917 | 23,563 |
| 2022                       | 4,169                           | 8,392  | 11,348 | 12,843 | 0      | 0      | 0      |

# Assessing Severity of the Blackouts

- The worst capacity shortfall is a 26 GW capacity shortfall that would occur in January 2040 using the 2021 HCY, accounting for 19.5 percent of the electricity demand at the time of the shortfall.
- This is the equivalent of needing to implement a blackout 12 minutes out of every hour.

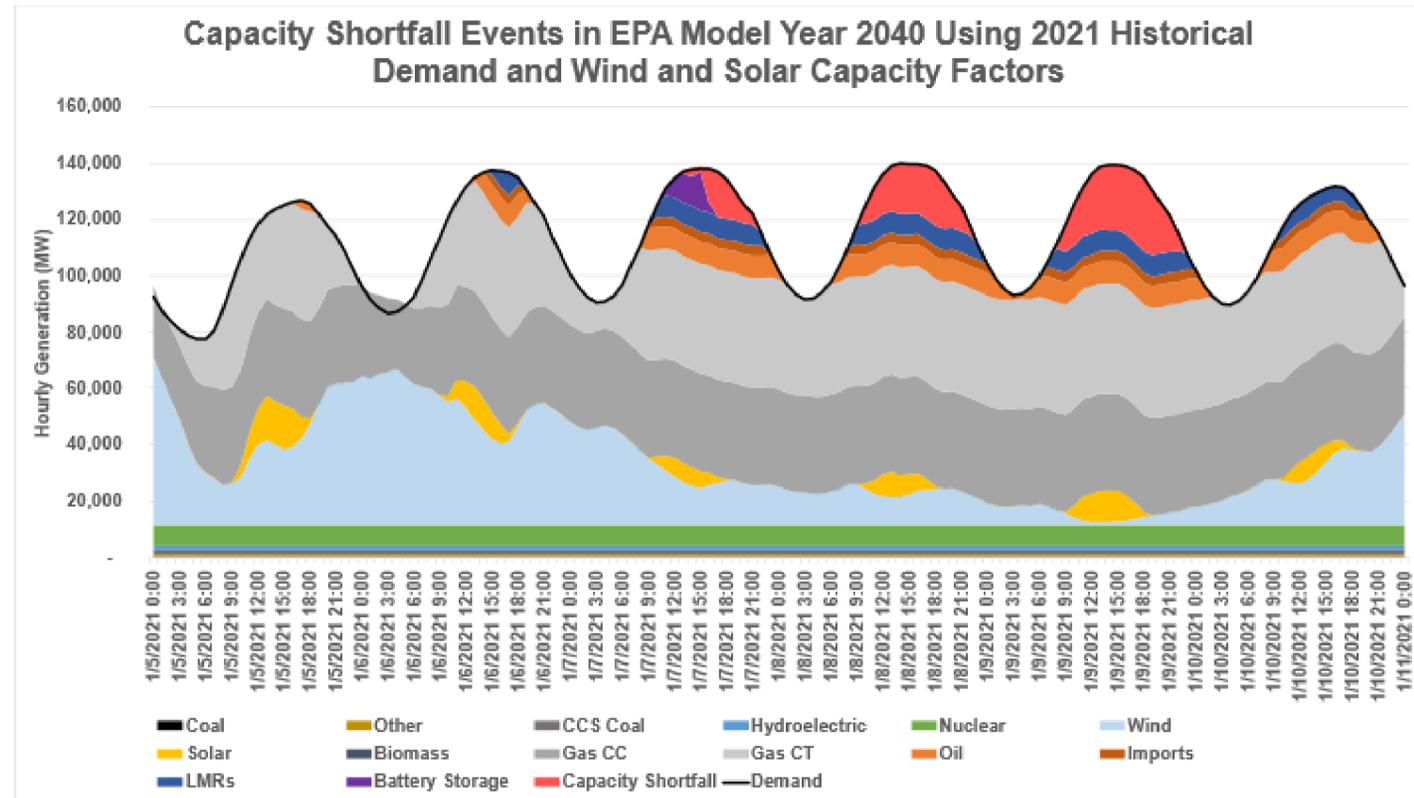

# Why do the Blackouts Occur?

- **Blackouts occur for several reasons:**

1. EPA assumes the base case scenario is adequate and reliable and adjusts the proposal scenario accordingly. This assumption could not be more wrong.
2. EPA is relying on variable wind and solar resources to meet its resource adequacy needs, but these generators frequently underperform their capacity accreditations, leaving the system short of energy.
3. EPA resource adequacy capacity accreditation values are hardly seen in the real-world by Regional Transmission Organizations (RTOs). For example, EPA uses 100 percent accreditation for thermal resources, compared to historical values of 80-90 percent by RTOs. Additionally, EPA uses different accreditation values for existing renewables and new renewables, whereas regional grids generally accredit these resources together.
4. EPA assumptions resulted in overestimating reliable capacity on the grid.
5. Shoring up EPA's grid requires building more capacity using reasonable capacity accreditations for all resources, especially wind and solar.

# Reliability Takeaways

- According to the preamble to the proposed rule, “EPA has carefully considered the importance of resource adequacy and grid reliability in developing these proposals and is confident that these proposed rules and emission guidelines ... can be successfully implemented in a manner that preserves the ability of power companies and grid operators to maintain the reliability of the nation’s electric power system.”
- EPA claims that its modeled resource portfolio will maintain resource adequacy and reliability out to 2055, but it cannot even reliably meet electricity demand while hindcasting the resource portfolio in MISO for any of the four previous years (2019, 2020, 2021, 2022).
- In order to claim the proposal can reliably serve load, EPA should have actually tested the reliability of the modeled grid.

# **Creating Reasonable Capacity Accreditation Metrics**

---

# Using More Realistic Capacity Accreditation Methods to Improve Resource Adequacy, Reliability, and Cost Measures


- EPA's accreditation for onshore wind and solar (both new and existing) are too high, which results in "Phantom Firm" resources in the capacity stack.
- This allows EPA's projected MISO grid to meet its reserve margin and resource adequacy criteria on paper, but not reality.
- More realistic capacity accreditation will increase the quality of resource adequacy calculations, the reliability of the system, and allow for a calculation of the true cost of EPA's proposed rules.

# EPA's Accreditation Values for Wind and Solar Are Too High


- EPA's accreditation for onshore wind and solar (both new and existing) are too high.
- For example, MISO gives existing wind and solar a
- EPA's decision to give different values to new and existing wind and solar doesn't make sense.

| EPA's Proposed 111 Regulations |                                      |
|--------------------------------|--------------------------------------|
| Resource                       | EPA's Capacity Accreditation in MISO |
| Existing Onshore Wind          | 19%                                  |
| Existing Solar                 | 55%                                  |
| New Onshore Wind               | 9%-25%                               |
| New Solar                      | 32%-52%                              |
| Existing Thermal               | 100%                                 |
| Existing Hydro                 | 56%                                  |
| New Hydro                      | 65%                                  |
| Existing Energy Storage        | 48%                                  |
| Pumped Storage                 | 95%                                  |
| New Battery Storage            | 100%                                 |

# EPA's Yearly Capacity Values

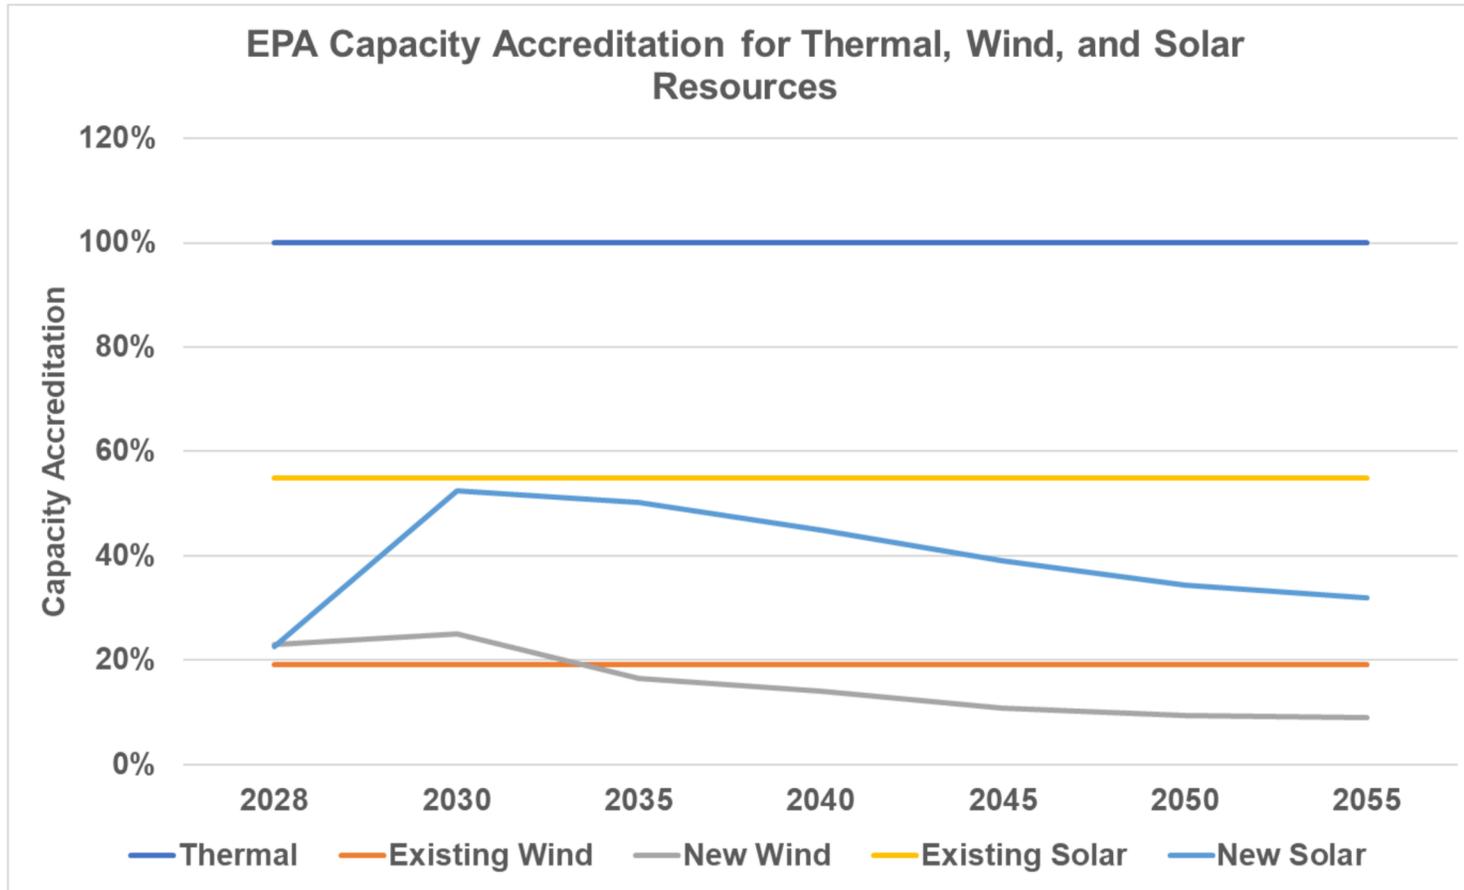


# Unreasonably High Capacity Values Can Result in Energy Shortfalls

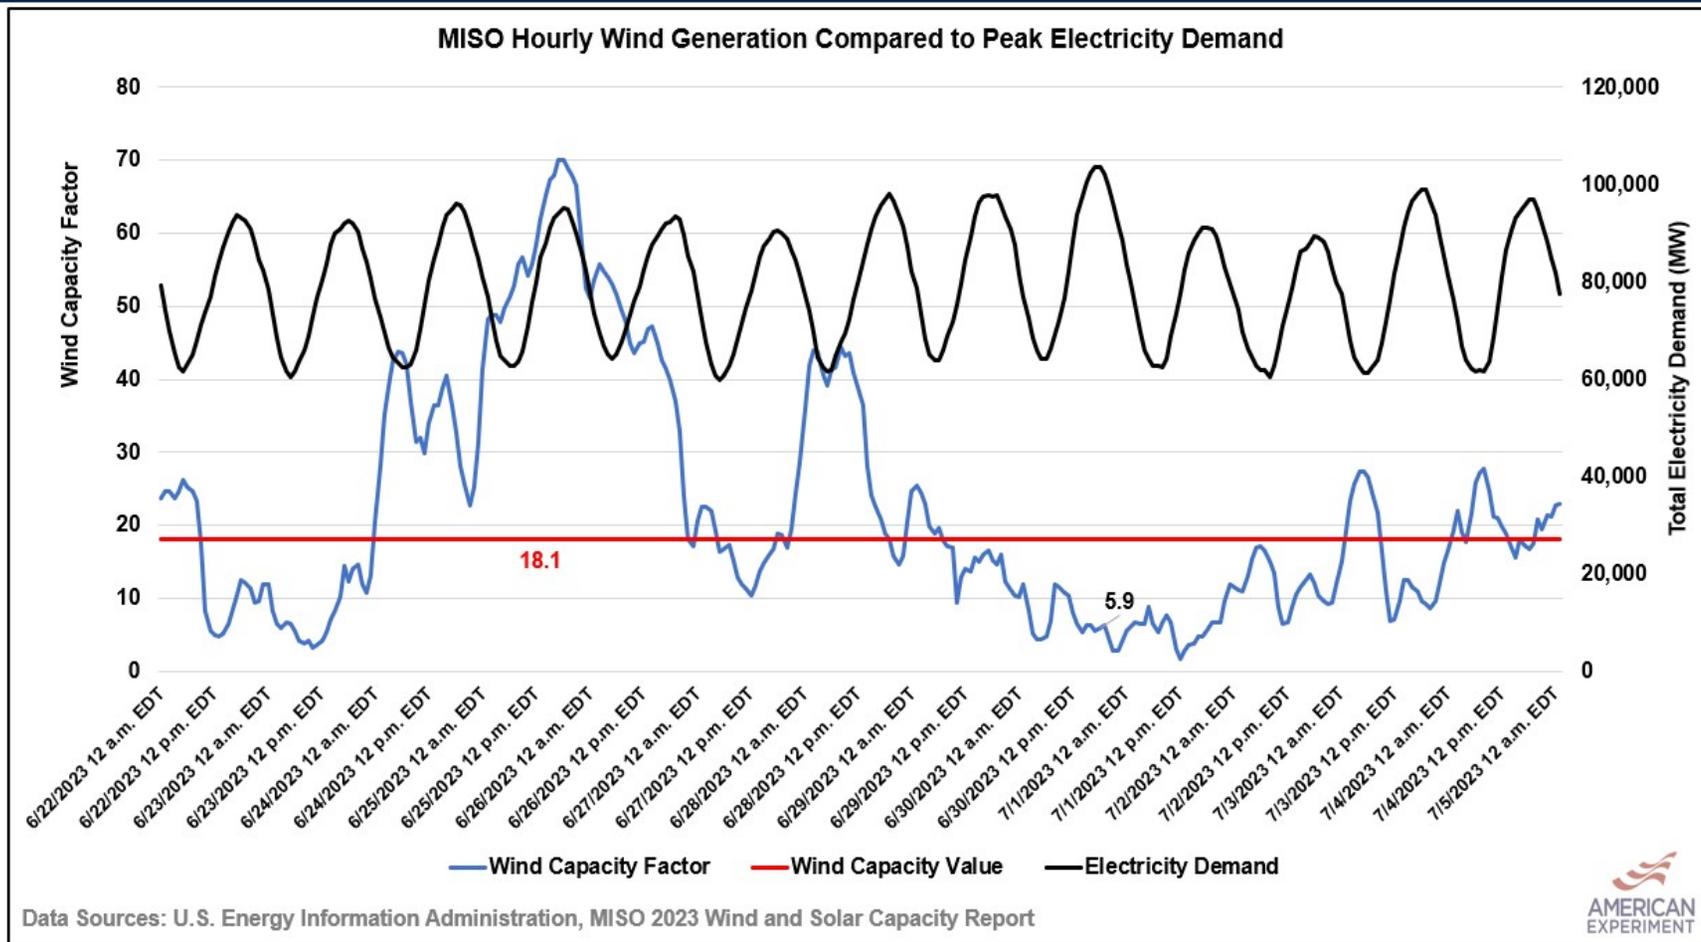

# Creating Reasonable Accreditation Values for Wind and Solar

## Assess wind and solar variability during peak load and net peak load hours

- As electric grids experience rising penetrations of intermittent resources, meeting **net** peak load will become increasingly challenging.
- **Peak Load:** The hours with the highest electricity demand.
- **Net peak load:** Gross demand minus wind and solar generation, which allows us to assess the highest demand hours where wind and solar output is the lowest.
- This is the standard new wind and solar resources should be judged by going forward.

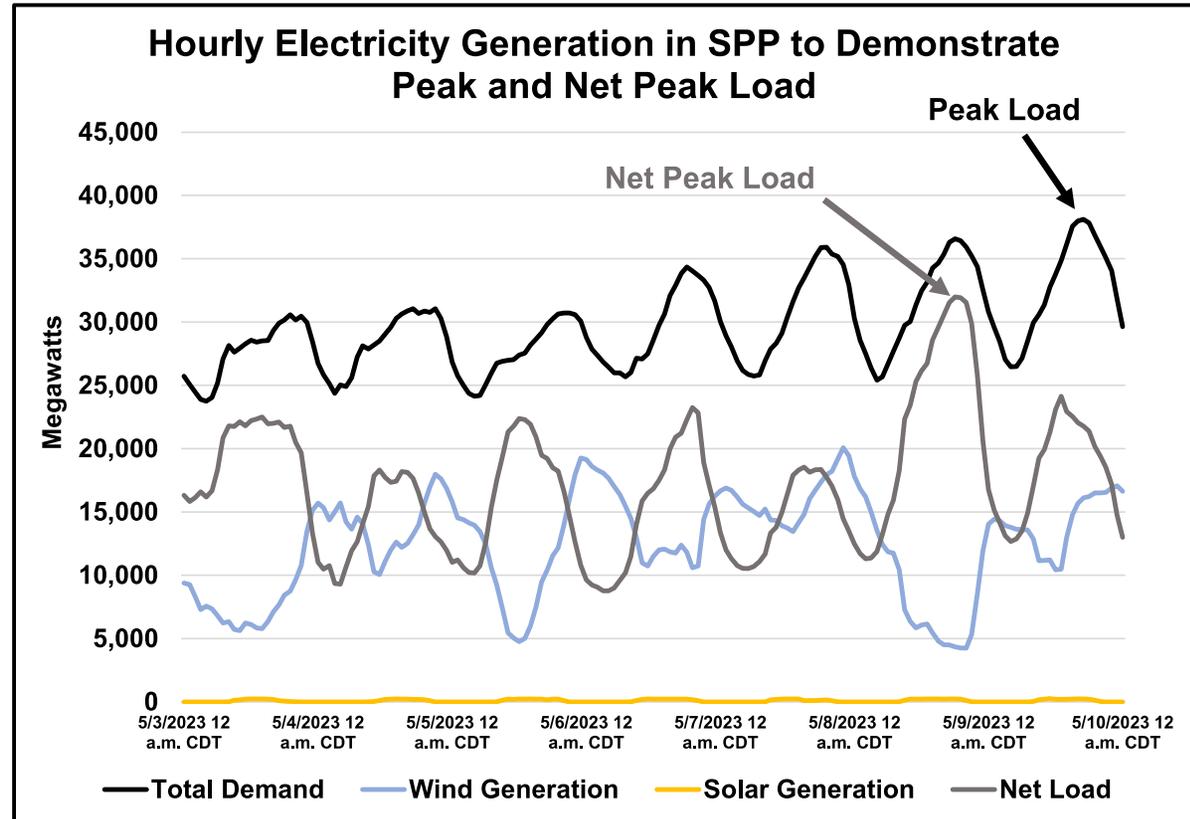

# Methodology- Developing a Standardized Capacity Accreditation for Renewable Resources

**Assess wind and solar variability during peak load and net peak load hours.**

- Used the last 4 years of data from EIA Hourly Grid Monitor and Form 923. Peak and net peak occurred on July 19, 2019, and August 25, 2021, respectively.
- Highest Certainty Deliverability (HCD) to assess wind and solar accreditation.
  - Sample size of 2,000 hours for wind & solar of the highest peak & net peak hours across 4 years.
  - Took the mean of the lowest 25 percent of wind and solar output during those hours to determine our accredited capacity values for peak and net peak.
- Using this methodology, we developed peak capacity and net peak capacity values for wind and solar.

|       | Peak Accreditation | Net Peak Accreditation |
|-------|--------------------|------------------------|
| Wind  | 7.1%               | 5.8%                   |
| Solar | 12.4%              | 12.0%                  |

# Comparing Highest Certainty Deliverability (HCD) Accreditation to the EPA's Capacity Accreditation


## HCD APPROACH

| <b>Highest Certainty Deliverability</b> |                           |                               |
|---|---------------------------|-------------------------------|
| <b>Resource</b>                         | <b>Peak Accreditation</b> | <b>Net Peak Accreditation</b> |
| Wind                                    | 7.1%                      | 5.8%                          |
| Solar                                   | 12.4%                     | 12.0%                         |
| Battery Storage                         | 100.0%                    | 100.0%                        |
| Thermal                                 | 90.0%                     | 90.0%                         |
| Reserve Margin                          | 16.8%                     | 16.8%                         |

## EPA APPROACH

| <b>EPA's Proposed 111 Regulations</b> |   |
|---------------------------------------|---|
| <b>Resource</b>                       | <b>EPA's Capacity Accreditation in MISO</b> |
| Existing Onshore Wind                 | 19%   |
| Existing Solar                        | 55%   |
| New Onshore Wind                      | 9%-25%                                      |
| New Solar                             | 32%-52%                                     |
| Existing Thermal                      | 100%  |
| Existing Hydro                        | 56%   |
| New Hydro                             | 65%   |
| Existing Energy Storage               | 48%   |
| Pumped Storage                        | 95%   |
| New Battery Storage                   | 100%  |

# EPA's Modeled MISO Grid Does Not Meet Resource Adequacy Targets Using Real-World Accreditation Metrics

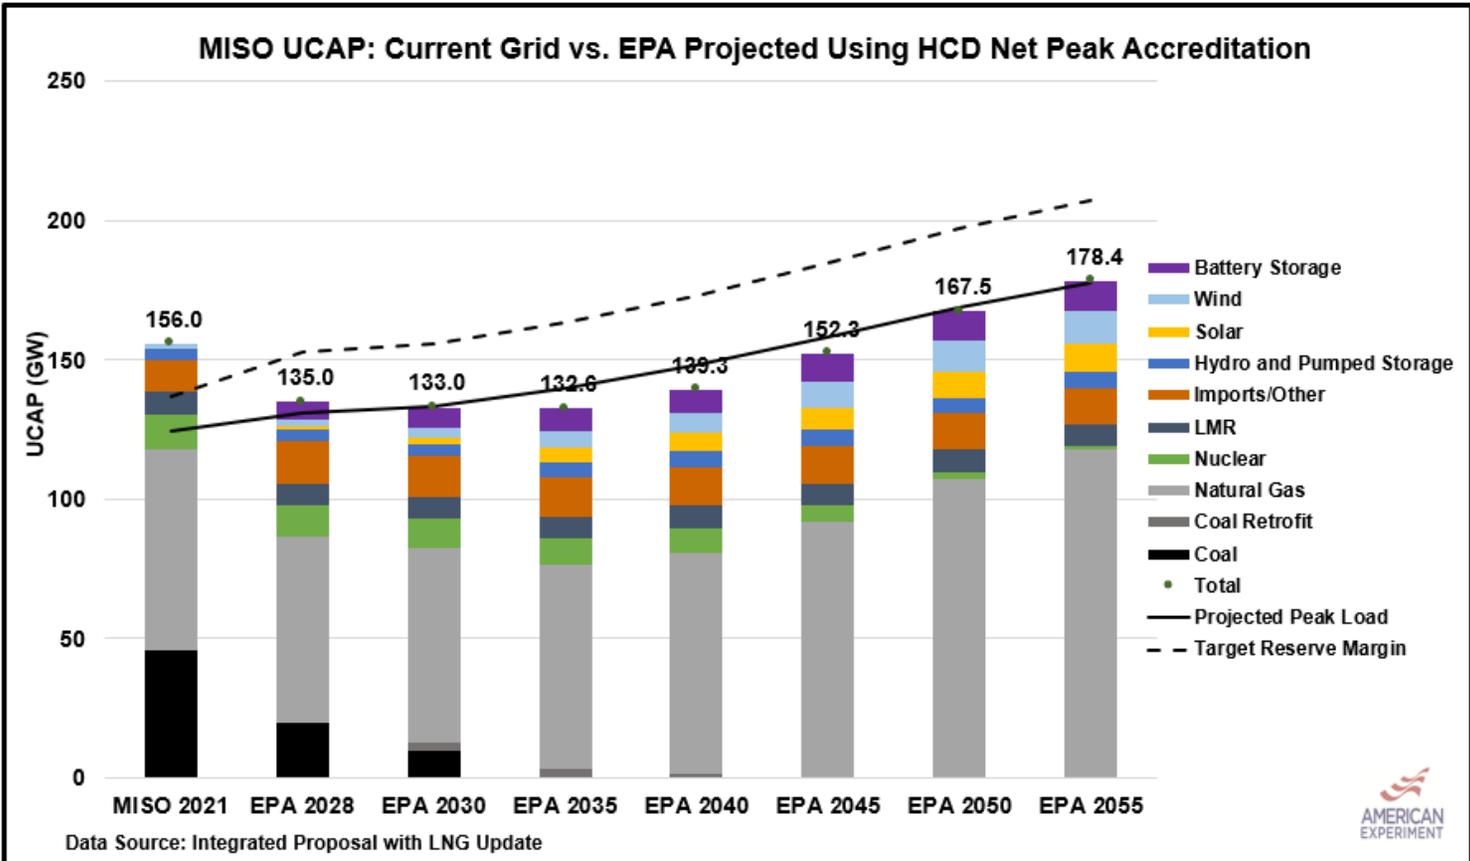

| Year        | Reserve Margin |
|-------------|----------------|
| 2022        | 25.6%          |
| <b>2028</b> | <b>3.3%</b>    |
| <b>2030</b> | <b>-.2%</b>    |
| <b>2035</b> | <b>-5.4%</b>   |
| <b>2040</b> | <b>-5.9%</b>   |
| <b>2045</b> | <b>-3.7%</b>   |
| <b>2050</b> | <b>.9%</b>     |
| <b>2055</b> | <b>.5%</b>     |

Estimated firm capacity using HCD accreditation values for wind, solar, storage, and thermal resources. EPA assumes a 16.8 percent reserve margin. Different than MISO cleared UCAP (unforced [accredited] capacity). Red indicates intermittent generation is necessary to meet Target Reserve Margins.



# Takeaways on Creating a Realistic Accreditation for Intermittent Renewable Resources

- Unrealistically optimistic resource accreditation for wind and solar leaves EPA with too many phantom firm resources and too few dispatchable power plants in its projected MISO grid under the proposed Section 111 rules.
- More realistic capacity accreditation indicates EPA needs significantly more capacity on the system to reliably meet electricity demand while meeting its proposed emissions targets.
- This additional capacity will be costly but necessary to meet electricity demand amidst modeled coal and natural gas retirements.

# **Calculating the True Cost of EPA's Proposed 111 Regulations**

---

# Calculating the Cost of Meeting EPA's Emissions Targets in the "Reliable 111 Rules" Scenario

**EPA's modeled grid is so unreliable that it is not a realistic basis for understanding the financial impact of the proposed Section 111 rules.**


- EPA assumes its Post-IRA base case maintains resource adequacy and reliability, but EPA's modeled resource portfolio is not reliable, and does not meet resource adequacy targets when realistic capacity accreditation values for wind, solar, and thermal resources are used.
- Meeting EPA's modeled emissions reductions in MISO while maintaining reliability will require an extensive capacity buildout of additional wind, solar, battery storage, and CT gas plants to provide sufficient electricity during periods of low wind and solar generation.
- This capacity buildout in this "Reliable 111 Rules" Scenario will be expensive, drastically changing the cost estimate of complying with the rules.
- These costs must be fully understood to make a reasoned cost/benefit analysis of the proposed rules.

# Reliability Criteria in the “Reliable 111 Rules” Scenario

- Evaluating the true cost of the EPA’s proposed Section 111 rules requires that its proposed grid meet electricity demand without rolling blackouts in the MISO region.
  - Solving for resource adequacy only, and not analyzing reliability, may be acceptable on a grid with sufficient dispatchable power plants. However, on grids that are heavily reliant on non-dispatchable, intermittent resources like wind and solar, traditional resource adequacy methods are not sufficient to maintain reliability because wind and solar may at times be performing below their accreditation values.
- American Experiment used the real-time hourly electricity demand and wind and solar capacity factors beginning January 1, 2019, and ran the model through December 31, 2022, requiring EPA’s modeled grid to meet electricity demand for every hour during this four-year period.
- Wind, solar, battery storage, and combustion turbine (CT) natural gas plants are added as needed to maintain reliability on the power grid during the model run.
- **NOTE:** These incremental capacity additions are on top of the capacity additions baked into the Updated Baseline with LNG Update base case and the Integrated Proposal with LNG Update and therefore constitute an additional cost relative to these modeled scenarios by EPA.

# EPA's Emissions Estimates for MISO

- EPA assumes dramatic reductions in carbon dioxide emission in MISO during the modeled timeframe.
- Emissions fall from 257.2 million metric tons in 2028 to 30.1 million metric tons in 2055.
- Achieving these emissions reductions while maintaining reliability will require increasing the installed capacity of wind, solar, battery storage, and CT natural gas plants on the MISO system.

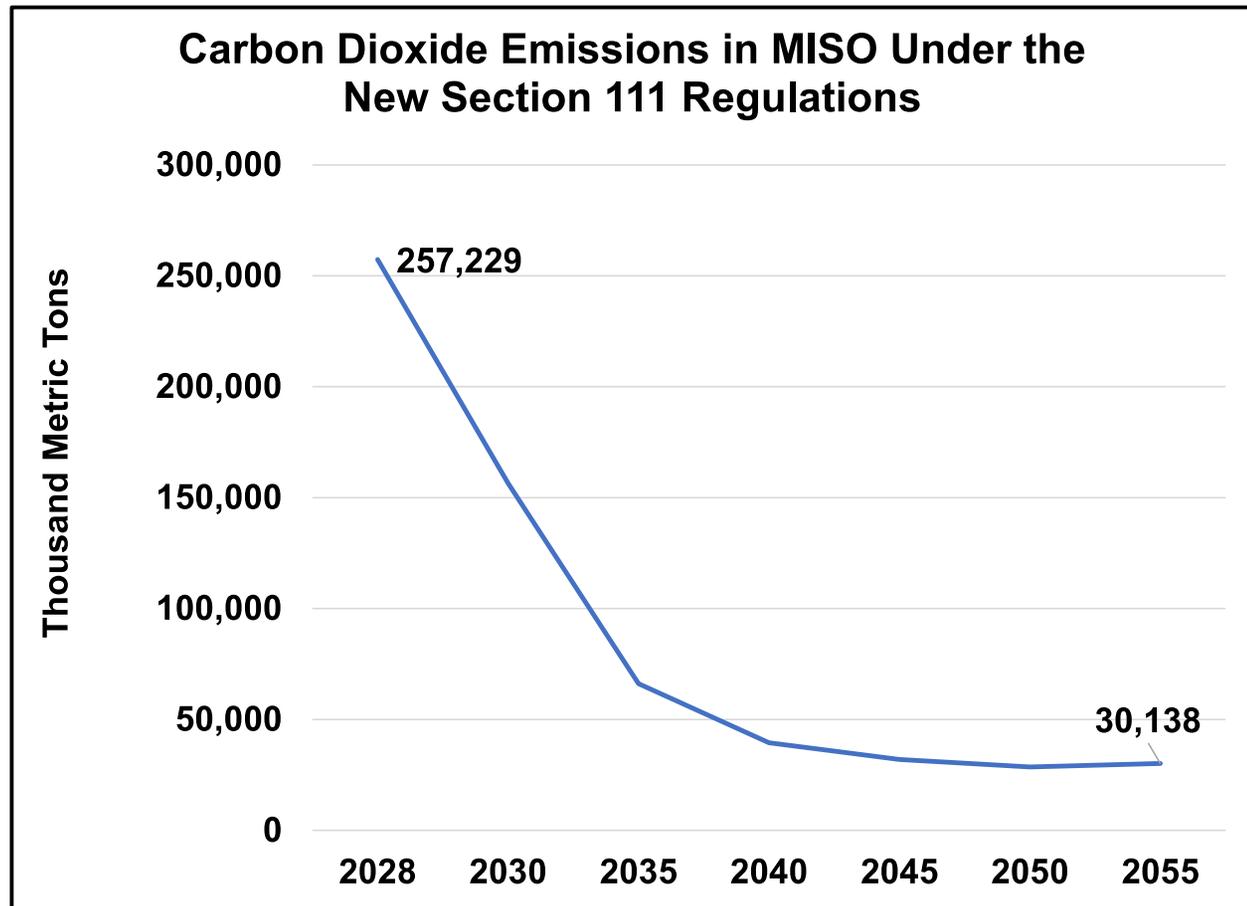

# Methodology- Capacity Additions and Retirements in the Reliable 111 Rules Scenario

## **Assessment of the cost of meeting reliability and resource adequacy need through 2055.**

- Used EPA's projected retirements and retrofits for coal, natural gas, and nuclear power plants in the Integrated Proposal with LNG Update in each model year.
- Assumed new capacity additions for wind, solar, battery storage, and CT natural gas plants are made as needed to ensure reliability in each of the target years.
- Additions occur in proportion to the UCAP capacity additions in EPA's Integrated Proposal with LNG Update. Net Peak HCD UCAP values are used for wind and solar resources.

# Methodology- Capacity Additions and Retirements

## Assessment of the cost of meeting reliability and resource adequacy needs through 2055 (cont'd)

- The replacement resource mix (the mix of wind, solar, battery storage, and CT natural gas added to replace retiring coal and natural gas power plants) is optimized for reliability, emissions targets, and cost.
  - The model also assumes all natural gas power plants will run below the thresholds requiring the use of CCS or co-firing green hydrogen.

# Methodology- Cost

**Assessment of the retail cost of replacing existing coal and natural gas resources with planned natural gas, wind, solar, and battery storage capacity.**

## **Assumptions include:**

- Capital costs based on weighted average of MISO regions in EIA's Assumptions to the Annual Energy Outlook Electricity Market Module.
- Rate of return assumption of 9.9 percent with debt/equity split of 48.92/51.08 based on the rate of return and debt/equity split of the ten-largest investor-owned utilities in MISO.
- Property tax costs of 1.3 percent of the rate base.
- Discount rate of 3.76.
- Transmission costs in accordance with the Electricity Futures Study published by the National Renewable Energy Laboratory and MISO's Transmission Cost Estimation Guide for MTEP22.
- Interconnection costs were determined by using the average cost of active projects at the point of interconnect, which is about \$48,000 per MW of wind and solar installed.
- EPA's assumed natural gas fuel costs are used throughout the model run.

Capital Costs:

<https://www.eia.gov/outlooks/aeo/assumptions/pdf/electricity.pdf>






# Reliable Section 111 Rules Scenario: Annual ICAP Mix (MW)

|                                   | 2022    | 2023    | 2024    | 2025    | 2026    | 2027    | 2028    | 2029    | 2030    | 2031    | 2032    | 2033    | 2034    | 2035    | 2036    | 2037    | 2038    |
|-----------------------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|
| <b>Coal</b>                       | 50,772  | 50,772  | 44,961  | 39,151  | 33,340  | 27,529  | 21,719  | 16,322  | 10,925  | 8,751   | 6,576   | 4,402   | 2,228   | 54      | 54      | 54      | 54      |
| <b>Natural Gas (CC)</b>           | 32,981  | 32,981  | 33,733  | 34,485  | 35,236  | 35,988  | 36,740  | 36,740  | 36,740  | 36,540  | 36,340  | 36,140  | 35,940  | 35,740  | 35,740  | 35,740  | 35,740  |
| <b>Natural Gas (CT)</b>           | 29,570  | 29,570  | 33,126  | 36,683  | 40,240  | 43,797  | 47,353  | 49,747  | 52,140  | 54,664  | 57,188  | 59,712  | 62,235  | 64,759  | 66,342  | 67,926  | 69,509  |
| <b>Oil/Gas</b>                    | 22,145  | 22,145  | 19,731  | 17,316  | 14,902  | 12,488  | 10,073  | 10,073  | 10,073  | 9,972   | 9,871   | 9,770   | 9,669   | 9,568   | 9,566   | 9,563   | 9,561   |
| <b>Hydro &amp; Pumped Storage</b> | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   |
| <b>Nuclear</b>                    | 13,026  | 13,026  | 12,741  | 12,456  | 12,171  | 11,886  | 11,601  | 11,304  | 11,008  | 10,764  | 10,520  | 10,276  | 10,032  | 9,788   | 9,788   | 9,788   | 9,788   |
| <b>Other</b>                      | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   |
| <b>Wind</b>                       | 30,340  | 30,340  | 37,488  | 44,636  | 51,784  | 58,932  | 66,080  | 84,510  | 102,941 | 112,078 | 121,215 | 130,352 | 139,489 | 148,626 | 156,077 | 163,528 | 170,979 |
| <b>Solar</b>                      | 1,997   | 1,997   | 6,243   | 10,489  | 14,735  | 18,981  | 23,227  | 32,498  | 41,770  | 47,758  | 53,746  | 59,735  | 65,723  | 71,608  | 74,564  | 77,520  | 80,475  |
| <b>Biomass</b>                    | 1,254   | 1,254   | 1,016   | 779     | 542     | 305     | 68      | 63      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      |
| <b>Storage</b>                    | 0       | 0       | 2,299   | 4,598   | 6,897   | 9,197   | 11,496  | 12,478  | 13,460  | 13,788  | 14,116  | 14,444  | 14,772  | 15,100  | 15,224  | 15,348  | 15,472  |
| <b>Total</b>                      | 192,166 | 192,166 | 201,421 | 210,675 | 219,929 | 229,184 | 238,438 | 263,818 | 289,198 | 304,456 | 319,713 | 334,971 | 350,229 | 365,384 | 377,495 | 389,607 | 401,719 |


  

| 2039    | 2040    | 2041    | 2042    | 2043    | 2044    | 2045    | 2046    | 2047    | 2048    | 2049    | 2050    | 2051    | 2052    | 2053    | 2054    | 2055    |     |
|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|-----|
| 54      | 54      | 54      | 54      | 54      | 54      | 54      | 46      | 38      | 31      | 23      | 15      | 15      | 15      | 15      | 15      | 15      | 0%  |
| 35,740  | 35,740  | 35,513  | 35,286  | 35,059  | 34,832  | 34,605  | 34,605  | 34,605  | 34,605  | 34,605  | 34,605  | 34,605  | 34,605  | 34,605  | 34,605  | 34,605  | 6%  |
| 71,093  | 72,676  | 75,757  | 78,838  | 81,918  | 84,999  | 88,080  | 91,501  | 94,921  | 98,342  | 101,763 | 105,183 | 107,581 | 109,978 | 112,375 | 114,772 | 117,170 | 20% |
| 9,558   | 9,555   | 9,555   | 9,555   | 9,555   | 9,555   | 9,555   | 9,338   | 9,121   | 8,904   | 8,687   | 8,470   | 8,470   | 8,470   | 8,470   | 8,470   | 8,470   | 1%  |
| 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 6,962   | 1%  |
| 9,788   | 9,788   | 9,036   | 8,285   | 7,534   | 6,783   | 6,031   | 5,397   | 4,762   | 4,127   | 3,493   | 2,858   | 2,483   | 2,108   | 1,734   | 1,359   | 984     | 0%  |
| 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 3,120   | 1%  |
| 178,430 | 185,881 | 193,775 | 201,669 | 209,563 | 217,457 | 225,351 | 230,370 | 235,390 | 240,410 | 245,430 | 250,449 | 254,587 | 258,724 | 262,861 | 266,999 | 276,136 | 47% |
| 83,431  | 86,387  | 88,431  | 90,474  | 92,518  | 94,562  | 96,606  | 99,124  | 101,642 | 104,160 | 106,678 | 109,196 | 111,405 | 113,613 | 115,822 | 118,031 | 120,239 | 21% |
| 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 58      | 0%  |
| 15,596  | 15,720  | 16,050  | 16,380  | 16,709  | 17,039  | 17,369  | 17,533  | 17,696  | 17,860  | 18,024  | 18,188  | 18,188  | 18,188  | 18,188  | 18,188  | 18,188  | 3%  |
| 413,830 | 425,942 | 438,312 | 450,682 | 463,052 | 475,422 | 487,792 | 498,054 | 508,317 | 518,580 | 528,843 | 539,106 | 547,474 | 555,843 | 564,211 | 572,580 | 585,948 |     |

# Results- Total Installed Capacity in Reliable 111 Rules Scenario (ICAP)

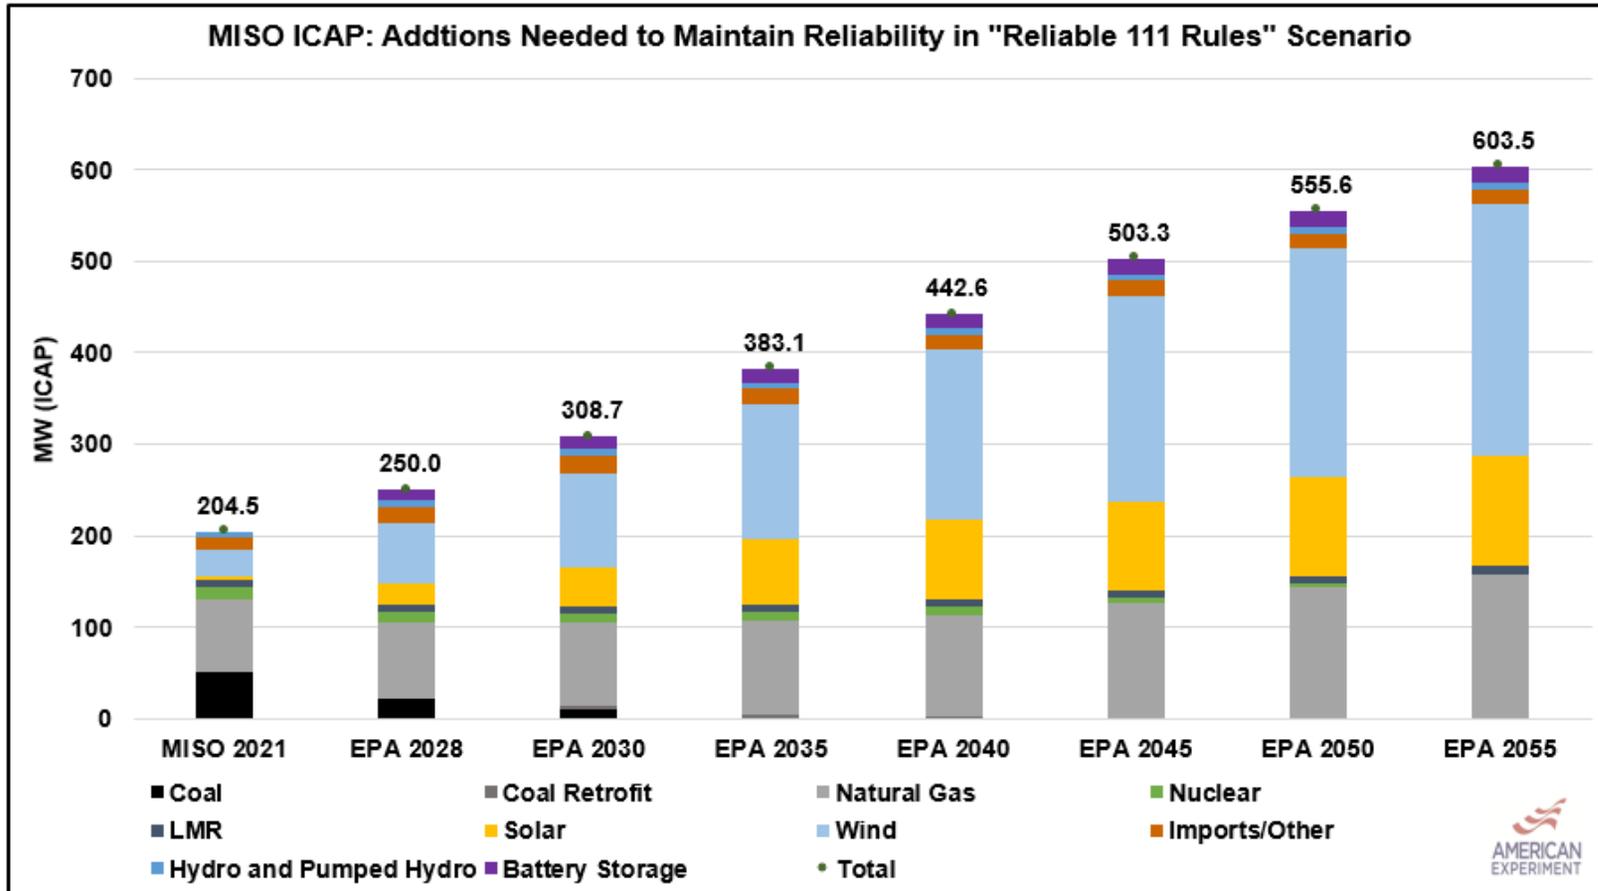


# Results- Difference in Installed Capacity: EPA's Modeled Grid vs. Reliable 111 Rules Scenario (ICAP)

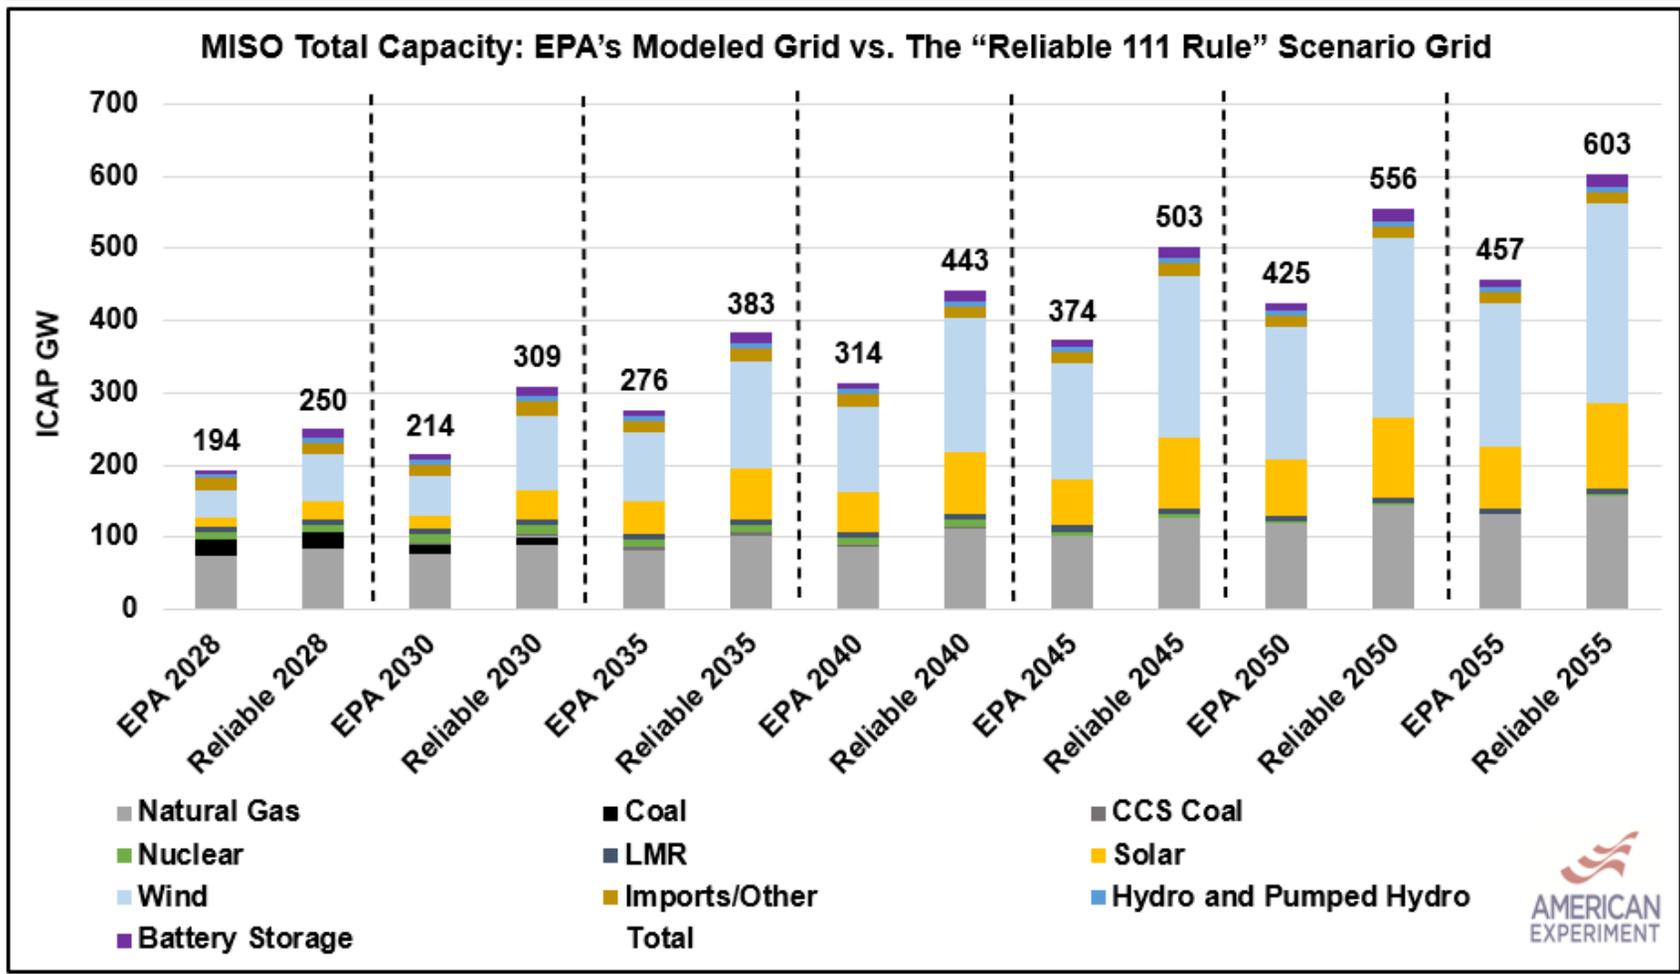


# and Additions (ICAP)

## Annual Capacity Additions and Retirements

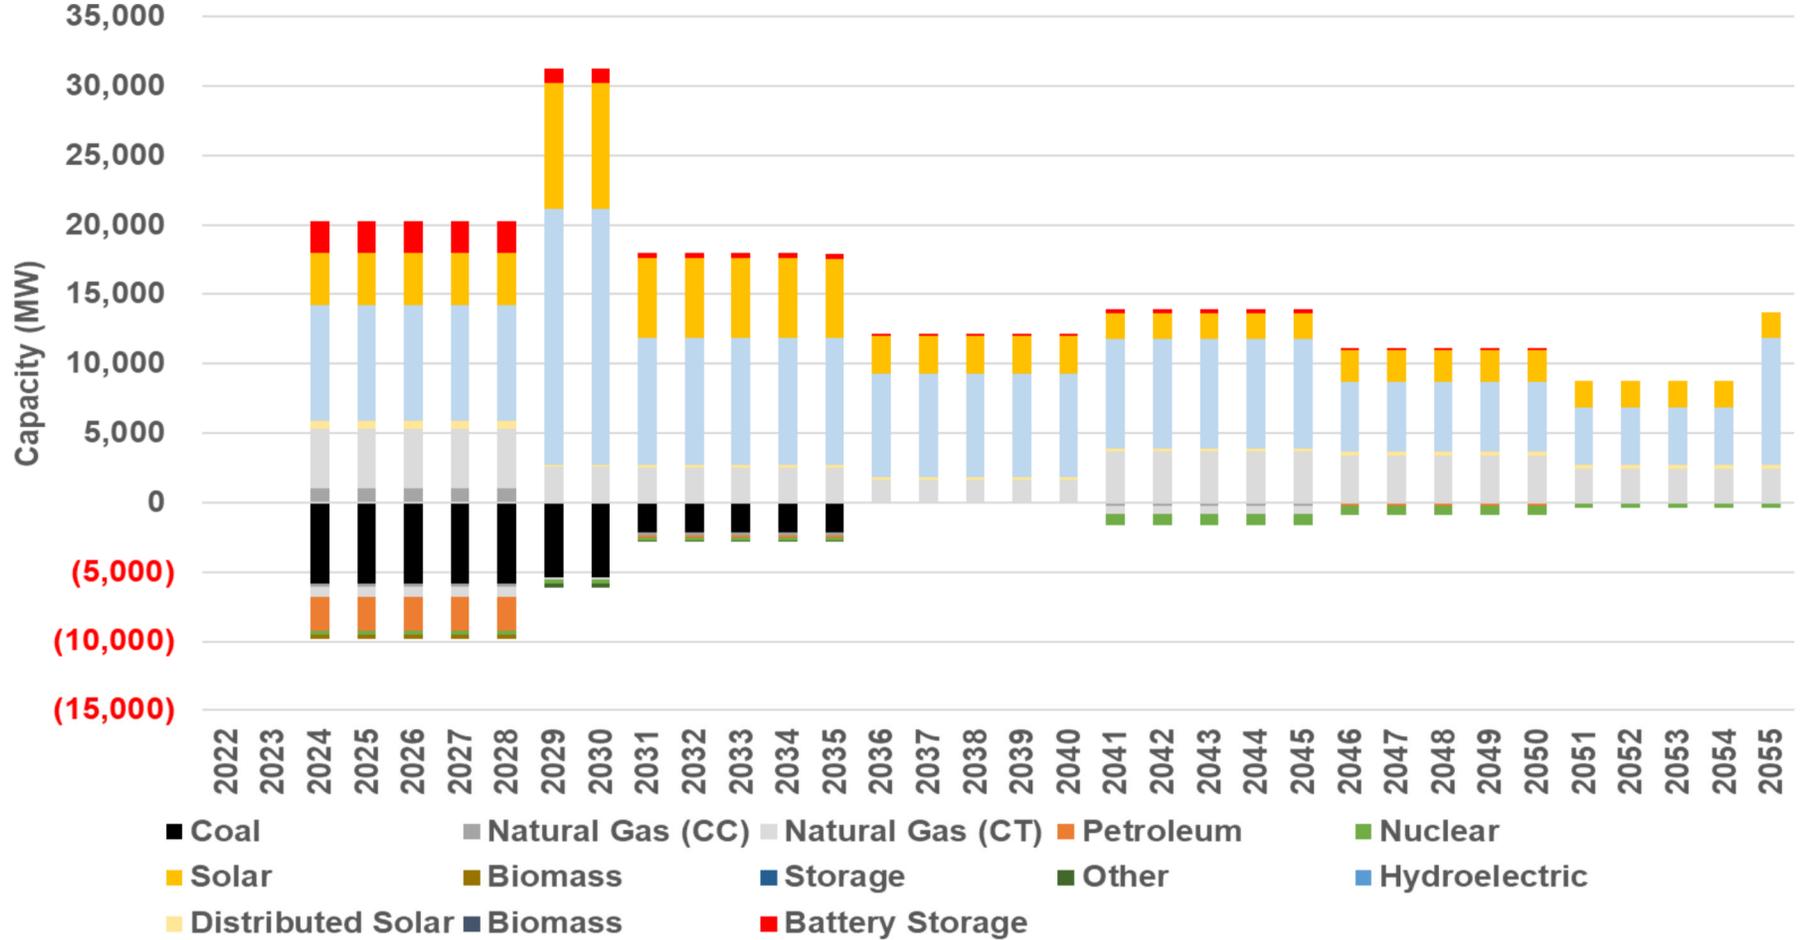


# Reliable Section 111 Rules Scenario: Retirements and Additions Through 2055 (ICAP)

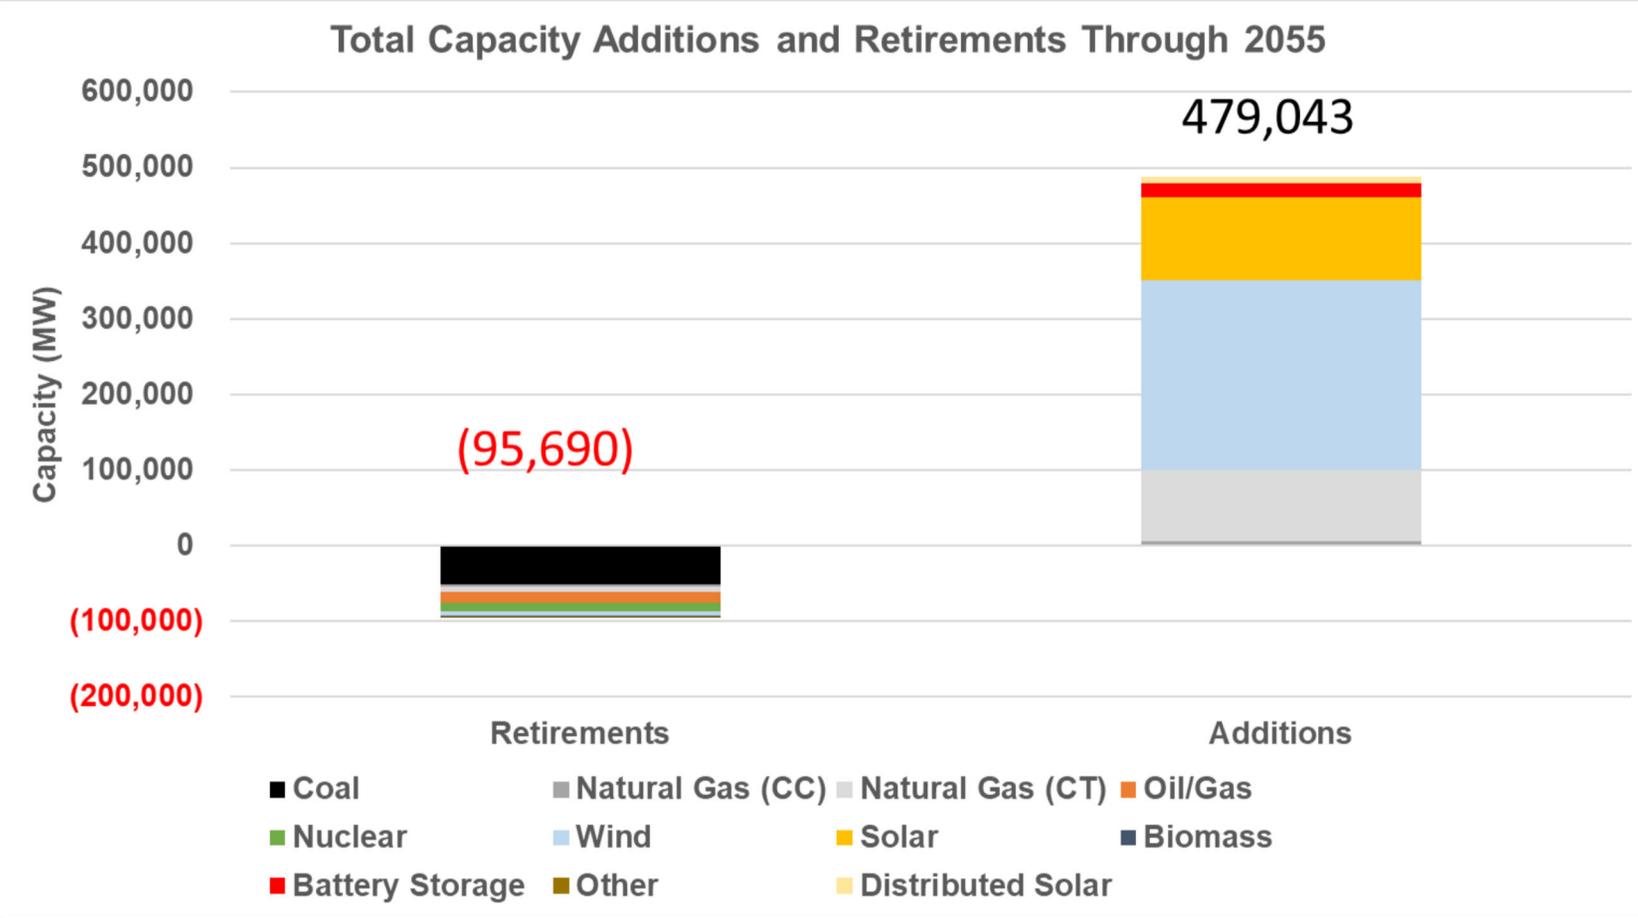


# Reliable Section 111 Rules Scenario: Current ICAP vs. 2055

Current ICAP

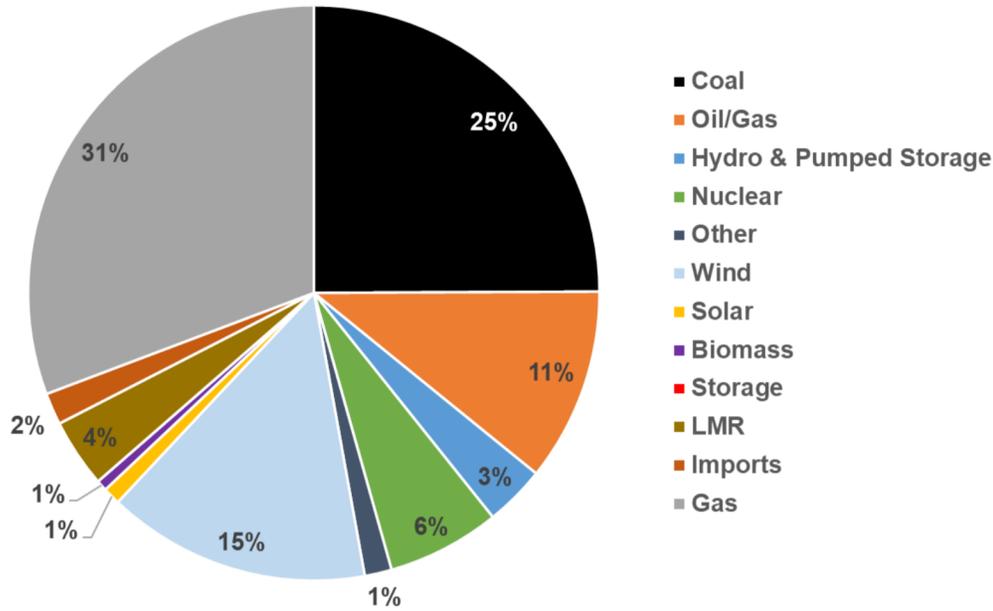

ICAP in 2055

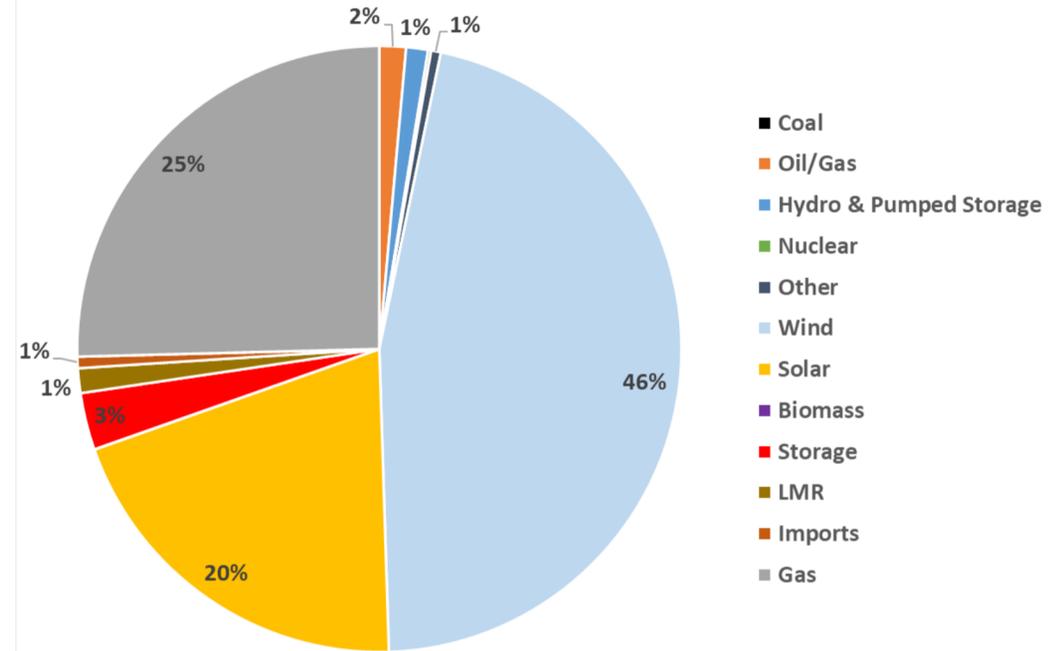


# Reliable Section 111 Rules Scenario: Annual UCAP Mix (MW)


|                         | 2021        | 2022        | 2023        | 2024        | 2025        | 2026        | 2027        | 2028        | 2029        | 2030        | 2031        | 2032        | 2033        | 2034        | 2035        | 2036        | 2037    | 2038    |
|-------------------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|---------|---------|
| <b>Coal</b>             | 45,695      | 45,695      | 45,695      | 40,465      | 35,235      | 30,006      | 24,776      | 19,547      | 14,689      | 9,832       | 7,875       | 5,919       | 3,962       | 2,005       | 48          | 48          | 48      | 48      |
| <b>Natural Gas (CC)</b> | 29,683      | 29,683      | 29,683      | 30,360      | 31,036      | 31,713      | 32,389      | 33,066      | 33,066      | 33,066      | 32,886      | 32,706      | 32,526      | 32,346      | 32,166      | 32,166      | 32,166  | 32,166  |
| <b>Natural Gas (CT)</b> | 26,613      | 26,613      | 26,613      | 29,814      | 33,015      | 36,216      | 39,417      | 42,618      | 44,772      | 46,926      | 49,198      | 51,469      | 53,740      | 56,012      | 58,283      | 59,708      | 61,133  | 62,558  |
| <b>Other</b>            | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808   | 2,808   |
| <b>Natural Gas (ST)</b> | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -       | -       |
| <b>Petroleum</b>        | 19,930      | 19,930      | 19,930      | 17,758      | 15,585      | 13,412      | 11,239      | 9,066       | 9,066       | 9,066       | 8,975       | 8,884       | 8,793       | 8,702       | 8,611       | 8,609       | 8,607   | 8,605   |
| <b>Hydro</b>            | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845   | 4,845   |
| <b>Nuclear</b>          | 12,374      | 12,374      | 12,374      | 12,104      | 11,833      | 11,562      | 11,291      | 11,020      | 10,739      | 10,457      | 10,225      | 9,994       | 9,762       | 9,530       | 9,298       | 9,298       | 9,298   | 9,298   |
| <b>Biomass</b>          | 1,128       | 1,128       | 1,128       | 915         | 701         | 488         | 274         | 61          | 57          | 52          | 52          | 52          | 52          | 52          | 52          | 52          | 52      | 52      |
| <b>Wind</b>             | 1,758       | 1,758       | 1,758       | 2,172       | 2,586       | 3,000       | 3,414       | 3,828       | 4,896       | 5,963       | 6,493       | 7,022       | 7,551       | 8,081       | 8,610       | 9,042       | 9,473   | 9,905   |
| <b>Solar</b>            | 239         | 239         | 239         | 748         | 1,256       | 1,765       | 2,274       | 2,782       | 3,893       | 5,003       | 5,721       | 6,438       | 7,155       | 7,873       | 8,577       | 8,932       | 9,286   | 9,640   |
| <b>Imports</b>          | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638   | 3,638   |
| <b>LMR</b>              | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875   | 7,875   |
| <b>Storage</b>          | -           | -           | -           | 2,299       | 4,598       | 6,897       | 9,197       | 11,496      | 12,478      | 13,460      | 13,788      | 14,116      | 14,444      | 15,100      | 15,224      | 15,224      | 15,348  | 15,472  |
| <b>Total UCAP</b>       | 156,586     | 156,586     | 156,586     | 155,799     | 155,012     | 154,225     | 153,438     | 152,650     | 152,822     | 152,994     | 154,380     | 155,766     | 157,153     | 158,539     | 159,913     | 162,246     | 164,578 | 166,911 |
| <b>2039</b>             | <b>2040</b> | <b>2041</b> | <b>2042</b> | <b>2043</b> | <b>2044</b> | <b>2045</b> | <b>2046</b> | <b>2047</b> | <b>2048</b> | <b>2049</b> | <b>2050</b> | <b>2051</b> | <b>2052</b> | <b>2053</b> | <b>2054</b> | <b>2055</b> |         |         |
| 48                      | 48          | 48          | 48          | 48          | 48          | 48          | 41          | 34          | 28          | 21          | 14          | 14          | 14          | 14          | 14          | 14          | 0%      |         |
| 32,166                  | 32,166      | 31,962      | 31,757      | 31,553      | 31,349      | 31,144      | 31,144      | 31,144      | 31,144      | 31,144      | 31,144      | 31,144      | 31,144      | 31,144      | 31,144      | 31,144      | 15%     |         |
| 63,983                  | 65,408      | 68,181      | 70,954      | 73,726      | 76,499      | 79,272      | 82,351      | 85,429      | 88,508      | 91,586      | 94,665      | 96,823      | 98,980      | 101,138     | 103,295     | 105,453     | 50%     |         |
| 2,808                   | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 2,808       | 1%      |         |
| -                       | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | -           | 0%      |         |
| 8,602                   | 8,600       | 8,600       | 8,600       | 8,600       | 8,600       | 8,600       | 8,405       | 8,209       | 8,014       | 7,819       | 7,623       | 7,623       | 7,623       | 7,623       | 7,623       | 7,623       | 4%      |         |
| 4,845                   | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 4,845       | 2%      |         |
| 9,298                   | 9,298       | 8,585       | 7,871       | 7,157       | 6,443       | 5,730       | 5,127       | 4,524       | 3,921       | 3,318       | 2,715       | 2,359       | 2,003       | 1,647       | 1,291       | 935         | 0%      |         |
| 52                      | 52          | 52          | 52          | 52          | 52          | 52          | 52          | 52          | 52          | 52          | 52          | 52          | 52          | 52          | 52          | 52          | 0%      |         |
| 10,337                  | 10,768      | 11,226      | 11,683      | 12,140      | 12,597      | 13,055      | 13,345      | 13,636      | 13,927      | 14,218      | 14,509      | 14,748      | 14,988      | 15,228      | 15,467      | 15,997      | 8%      |         |
| 9,994                   | 10,348      | 10,593      | 10,837      | 11,082      | 11,327      | 11,572      | 11,873      | 12,175      | 12,477      | 12,778      | 13,080      | 13,344      | 13,609      | 13,874      | 14,138      | 14,403      | 7%      |         |
| 3,638                   | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 3,638       | 2%      |         |
| 7,875                   | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 7,875       | 4%      |         |
| 15,596                  | 15,720      | 16,050      | 16,380      | 16,709      | 17,039      | 17,369      | 17,533      | 17,696      | 17,860      | 18,024      | 18,188      | 18,188      | 18,188      | 18,188      | 18,188      | 18,188      | 9%      |         |
| 169,243                 | 171,576     | 174,462     | 177,349     | 180,235     | 183,122     | 186,009     | 189,038     | 192,068     | 195,097     | 198,127     | 201,156     | 203,462     | 205,768     | 208,074     | 210,380     | 212,975     |         |         |

# Reliable Section 111 Rules Scenario UCAP

MISO UCAP: Additional Capacity Needed For Reliable 111 Rule Scenario Net Peak HCD Accreditation

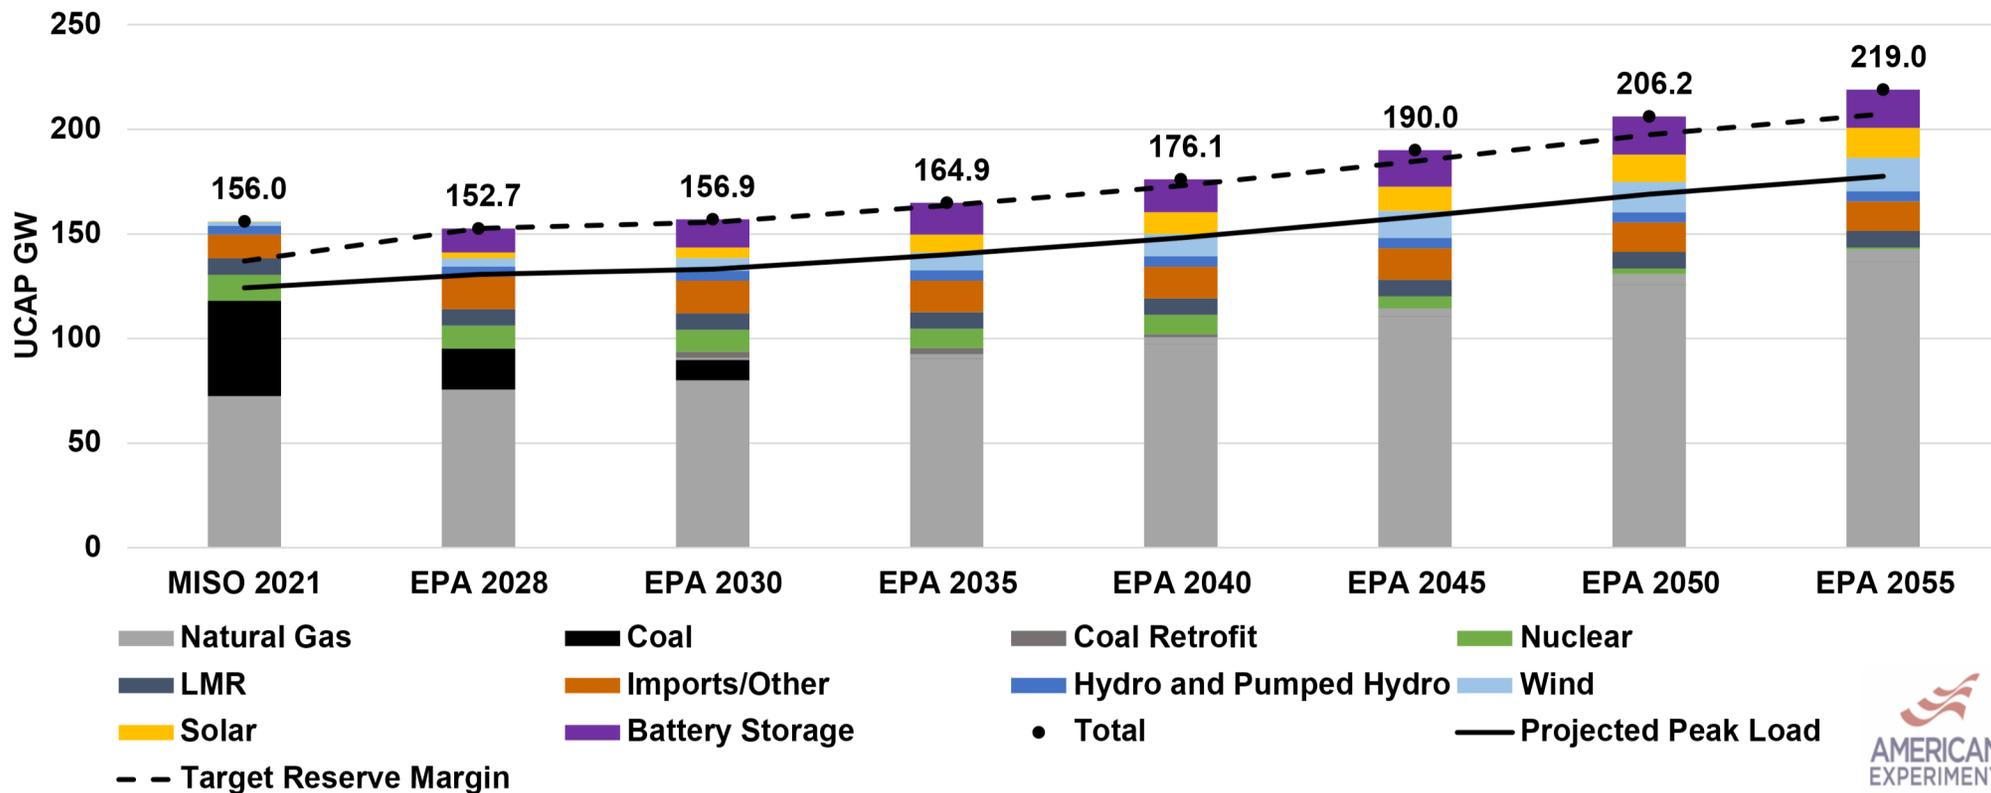

# Reliable Section 111 Rules Scenario: Capacity Shortfall Risk

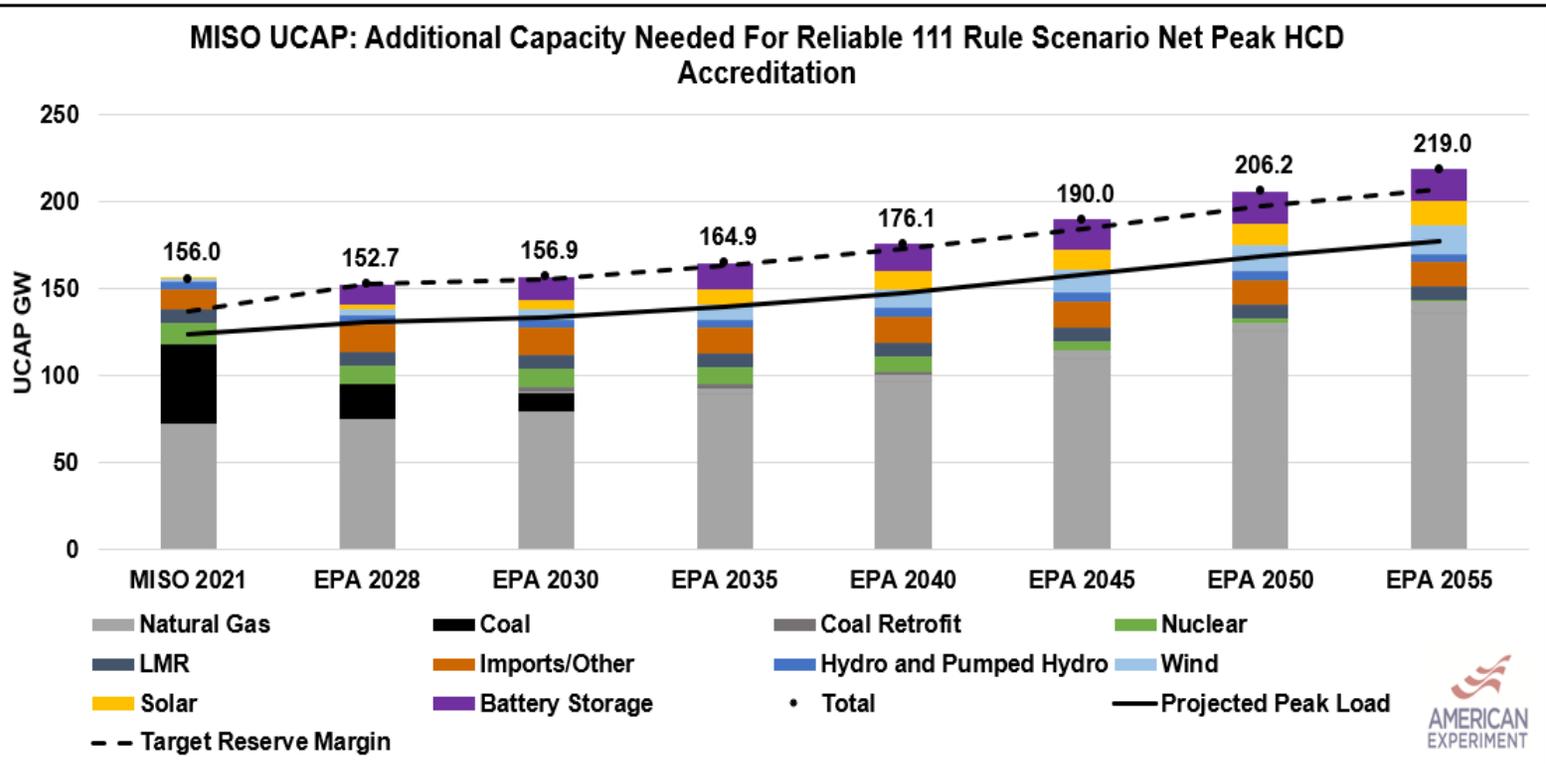


| Year        | Reserve Margin |
|-------------|----------------|
| 2022        | 25.6%          |
| <b>2028</b> | <b>16.8%</b>   |
| <b>2030</b> | <b>17.8%</b>   |
| <b>2035</b> | <b>17.7%</b>   |
| <b>2040</b> | <b>18.9%</b>   |
| <b>2045</b> | <b>20.1%</b>   |
| <b>2050</b> | <b>22%</b>     |
| <b>2055</b> | <b>23.3%</b>   |


Estimated firm capacity using net peak load capacity accreditation values for wind (5.8%) and solar (12%), 95% for nuclear, and 90% for other thermal generators. Different than MISO cleared UCAP (unforced [accredited] capacity). Under this scenario, MISO would be dependent on intermittent resources to meet peak load.

# Reliable Section 111 Rules Scenario: Current UCAP vs. 2035

## Current UCAP

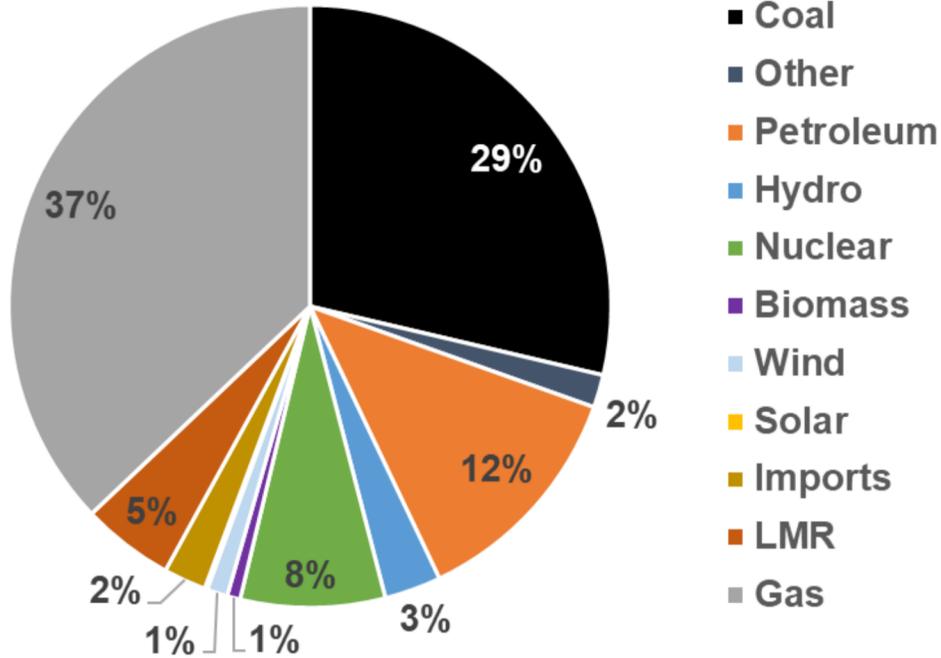


## UCAP in 2035

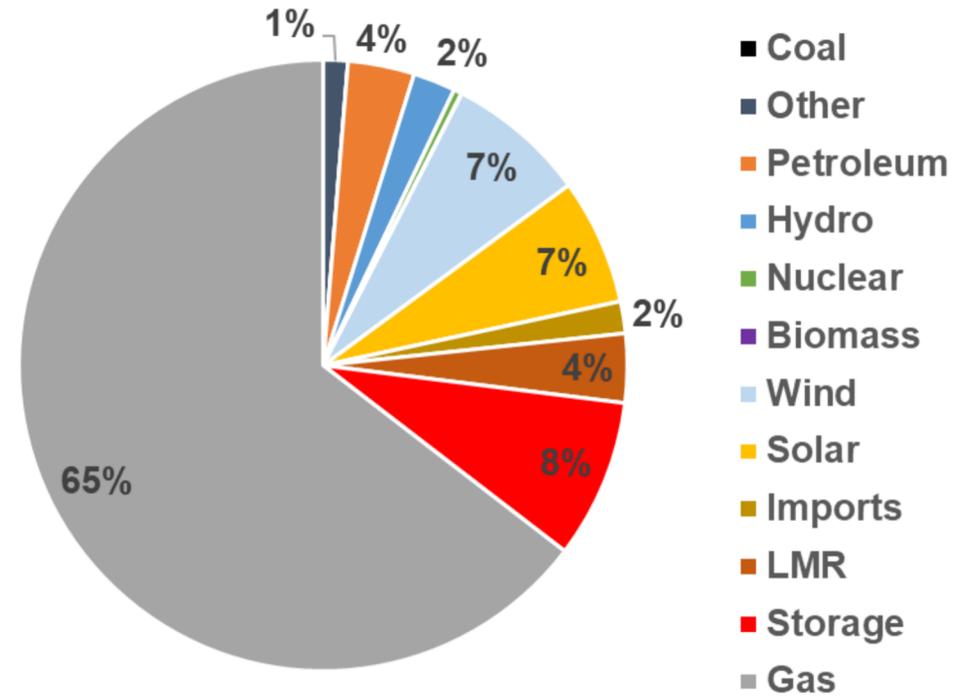

# Cost of Reliable Section 111 Rules Scenario


The total additional cost to ratepayers in the Reliable Section 111 Rule Scenario would be \$246 billion more than the modeled EPA grid.

- These cost estimates exclude the massive subsidies for wind, solar, and carbon capture in the IRA.
- Values are discounted at 3.7%, the same metric used by EPA.
- EPA values are originally in \$2019 and were adjusted for inflation.

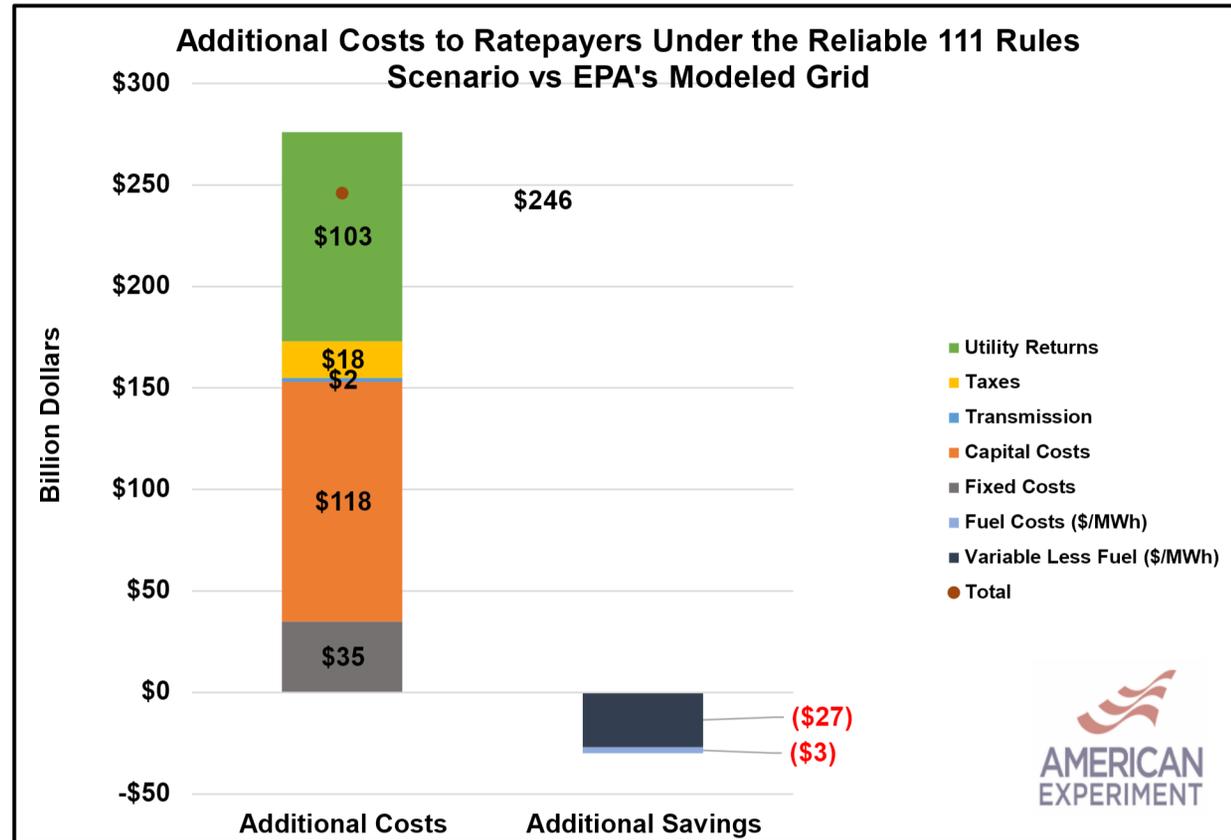

# Additional Costs of the Reliable 111 Rules Scenario

- The true cost of the proposed rules to ratepayers is \$246 billion in additional costs compared to the cost of EPA's modeled grid.
- This figure excludes IRA subsidies.
- This amounts to \$7.7 billion per year in additional compliance costs for ratepayers.
- This value exceeds EPA's estimated net benefits for the rules of \$5.9 billion per year *for the entire country in just one RTO.*

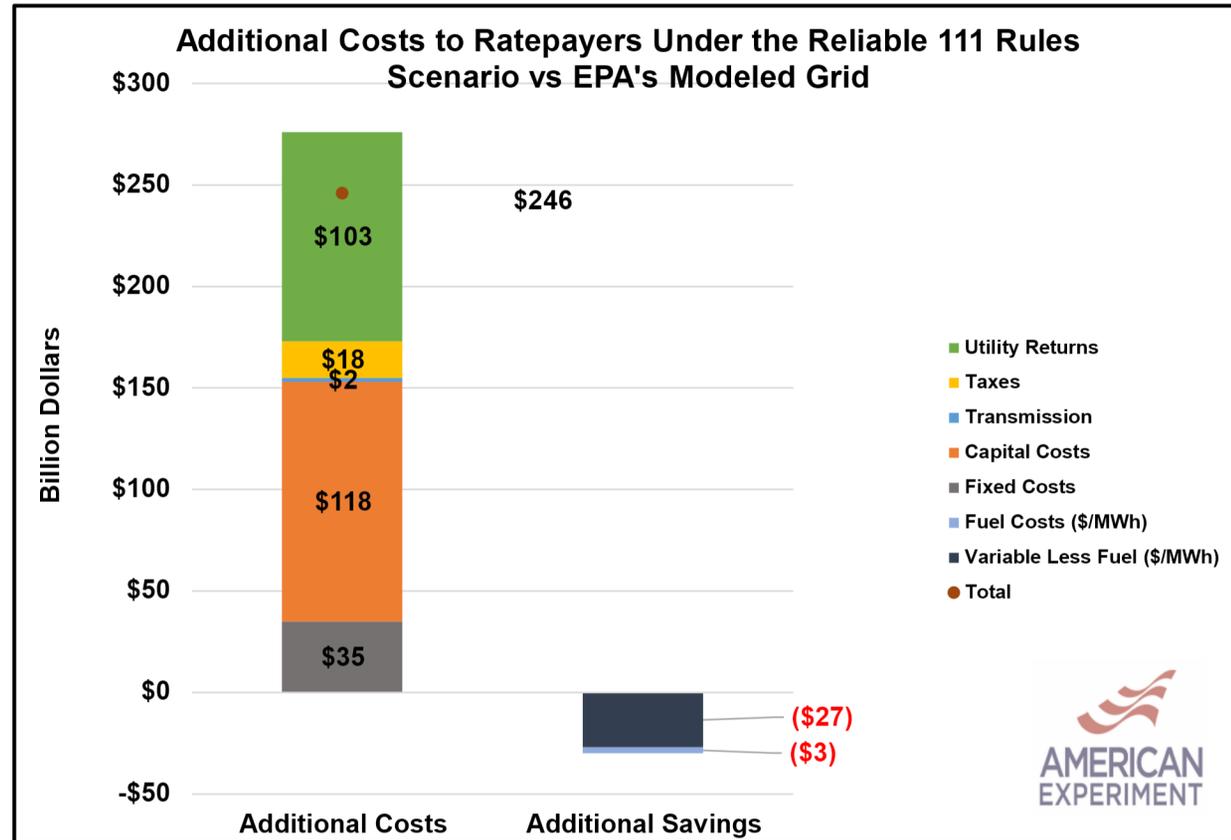

# Reliable 111 Rules Scenario Impact on Retail Electricity Prices

- EPA's RIA suggests the Proposed 111 Rules will have minimal impact on retail electricity rates.
- However, electricity rates in the Reliable 111 Rules Scenario increase substantially as a result of building enough capacity to prevent rolling blackouts.
- By 2040, electricity price increases will be 27.8 percent higher in the Reliable 111 Rules Scenario than in EPA's RIA.
- EPA values are originally in \$2019 and were adjusted for inflation.

Average MISO Retail Electricity Prices (\$2022 Cents Per kWh)

| Year | Reliable 111 Rules Scenario | EPA's RIA | Difference |
|------|-----------------------------|-----------|------------|
| 2030 | 11.27                       | 10.45     | .82        |
| 2035 | 11.66                       | 9.59      | 2.07       |
| 2040 | 12.00                       | 9.39      | 2.61       |

# Conclusions

- 1. EPA's projected capacity mix for the MISO region under the proposed Section 111 rules is unreliable, resulting in 607 of hours of capacity shortfalls in the EPA modeled years (2028, 2030, 2035, 2040, 2045, 2050, 2055) using historical data from 2019 to 2022.**
  - 2. Blackouts occur because EPA is using unrealistically high capacity values for intermittent wind and solar resources with insufficient dispatchable backup resources.**
  - 3. EPA's methodology downwardly biases the agency's cost estimates for the Proposed Section 111 rules.**
  - 4. Achieving EPA's stated emissions goals while maintaining reliability will cost ratepayers an additional \$246 billion through 2055. Taxpayers will pay billions more, as well.**
  - 5. Policymakers must understand the challenges regarding reliability, resiliency and affordability that are growing every year.**
-

# Recommendations

## **Policy Recommendations in Light of the Findings of the Study:**

1. **EPA MUST ASSESS RELIABILITY:** EPA is proposing massive changes to the U.S. electrical grid without performing the most basic reliability stress testing if its assumptions.
2. **STUDY REMAINING U.S. REGIONS:** MISO constitutes approximately 14 percent of the U.S. population. Similar analyses should be conducted for the rest of the country to determine if EPA's modeled grid can reliably meet electricity demand based on hourly load conditions and wind and solar performance.
3. **EXTEND THE PUBLIC COMMENT PERIOD:** In light of the massive shortcomings with EPA's analysis, the agency should extend the public comment period for at least 90 days so further reliability analysis can be conducted.

# Future Research

## **EPA is proposing massive changes to the electric generating fleet for the entire U.S.**

- Our findings represent the results in the MISO market, which serves 45 million Americans constituting only 13.6 percent of the U.S. population.
- More study is needed to evaluate the impact on reliability and affordability that the proposed Section 111 rules will have on the rest of the U.S. electric grid and to model the exchange of electricity between regions.
- More time is needed to evaluate these regions before the final rulemaking is issued. EPA should extend the comment period for the proposed rules by at least 60 days.

# APPENDIX

- What follows are slides documenting additional context / assumptions / background, ideas for potential future work, and other resources (including a “short version” of the slides) not included in the primary study slide deck.
-

# Electricity Demand, Consumption, and Reserve Margin Assumptions


- Annual electricity consumption is increased in accordance with EPA's assumptions in the IPM in each of the MISO subregions.
- The modeled peak demand and reserve margin in each of the model years is increased in accordance with the IPM in each of the MISO subregions in the Integrated Proposal with LNG Update.

# Time Horizon Studied

- This analysis studies the impact of the proposed Section 111 rules from 2024 through 2055 to capture the long-term cost of the regulations and to compare these costs to those generated by EPA.
- This timeline downwardly biases the cost of compliance with the regulations because power plants are long term investments, often paid off over a 30-year time period. This means the changes to the resource portfolio in MISO resulting from these rules will affect electricity rates for decades beyond 2055.

# Hourly Load, Capacity Factors, and Peak Demand Assumptions

- Hourly load shapes and wind and solar generation were determined using data for the entire MISO region obtained from EIA's Hourly Grid Monitor. Load shapes were obtained for 2019, 2020, 2021, and 2022.
- These inputs were entered into the model to assess hourly load shapes, capacity shortfalls, and calculate storage capacity needs.
- Capacity factors used for wind and solar facilities were adjusted upward to match EPA assumptions that new wind and solar facilities will have capacity factors as high as of 43.7 and 25.5 percent, respectively.
- This is a generous assumption because the current MISO-wide capacity factor of existing wind turbines is only 36 percent, and solar is 20 percent.
- Our analysis upwardly adjusted observed capacity factors to EPA's estimates despite the fact that EPA's assumptions for onshore wind are significantly higher than observed capacity factors reported from Lawrence Berkeley National Labs.

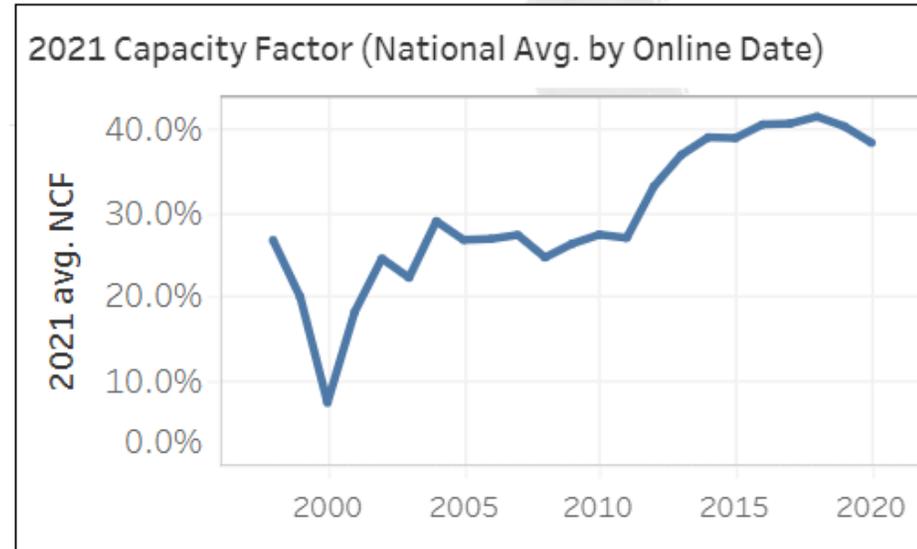

# Line Losses

- Line losses are assumed to be 5 percent of the electricity transmitted and distributed in the United States based on U.S. on EIA data from 2017 through 2021.
- Energy Information Administration, “How Much Electricity is Lost in Electricity Transmission and Distribution in the United States,” Frequently Asked Questions, <https://www.eia.gov/tools/faqs/faq.php?id=105&t=3>

# Battery Storage

- Battery storage facilities were assumed to be 4-hour storage, while pumped storage facilities were assumed to be 8-hour storage.
- Battery storage efficiency losses were 5 percent on both ends (charging and discharging).
- Maximum battery discharge was held to the maximum capacity rating less battery storage efficiency losses.
  - This is a generous assumption because it allows the entire battery to discharge and not be constrained by any other limits. Most battery storage units recommend a depth of discharge (DoD) of 80—95 percent.

# Value of Lost Load (VoLL)

- The value of lost load (VoLL) is a monetary indicator expressing the costs associated with an interruption of electricity supply, expressed in dollars per megawatt hour (MWh) of unserved electricity.
- Our analysis uses a conservative midpoint estimate of \$14,250 per MWh for VoLL. This value is higher than MISO's previous VoLL estimate of \$3,500 per MWh, but significantly lower than the Independent Market Monitor's suggested estimate of \$25,000 per MWh.
- Potomac Economics, "2022 State of the Market Report for the MISO Electricity Markets," Independent Market Monitor for the Midcontinent ISO, June 15, 2023, [https://www.potomaceconomics.com/wp-content/uploads/2023/06/2022-MISO-SOM\\_Report\\_Body-Final.pdf](https://www.potomaceconomics.com/wp-content/uploads/2023/06/2022-MISO-SOM_Report_Body-Final.pdf).

# Plant Retirement Schedules

- Our modeling does not make decisions about which individual plants will retire due to the proposed Section 111 rules. Rather, coal and natural gas plant capacity is retired to match the changes modeled by EPA in the Integrated Proposal with LNG Update.

# Load Modifying Resource, Demand Response, and Import Assumptions

- Our model allows for the use of 7,875 MW of Load Modifying Resources (LMRs) and 3,638 MW external resources (imports) in determining how much reliable capacity will be needed within MISO to meet peak electricity demand under the new Section 111 rules. These capacity assumptions represent an **XAMOUNT** increase relative to the MISO 2023-2024 Planning Reserve Margin Auction Results (See Table XMISOPRM).

## 2023-2024 Seasonal Supply Offered and Cleared

| Planning Resource           | Offered (ZRC)    |                  |                  |                  | Cleared (ZRC)    |                  |                  |                  |
|-----------------------------|------------------|------------------|------------------|------------------|------------------|------------------|------------------|------------------|
|                             | Summer 2023      | Fall 2023        | Winter 2023-2024 | Spring 2024      | Summer 2023      | Fall 2023        | Winter 2023-2024 | Spring 2024      |
| Generation                  | 122,375.6        | 121,403.5        | 122,375.6        | 121,403.5        | 116,989.7        | 111,713.8        | 116,989.7        | 110,195.8        |
| External Resources          | 4,514.6          | 4,095.4          | 4,514.6          | 4,095.4          | 4,072.5          | 3,979.6          | 4,072.5          | 3,409.1          |
| Behind the Meter Generation | 4,175.2          | 3,874.2          | 4,175.2          | 3,874.2          | 4,129.4          | 3,842.8          | 4,129.4          | 4,058.9          |
| Demand Resources            | 8,303.5          | 7,004.2          | 8,303.5          | 7,004.2          | 7,694.6          | 6,254.4          | 7,694.6          | 6,720.0          |
| Energy Efficiency           | 5.0              | 4.9              | 5.0              | 4.9              | 5.0              | 4.8              | 5.0              | 5.3              |
| <b>Total</b>                | <b>139,373.9</b> | <b>136,382.2</b> | <b>139,373.9</b> | <b>136,382.2</b> | <b>132,891.2</b> | <b>125,795.4</b> | <b>132,891.2</b> | <b>124,389.1</b> |

# Utility Returns

- Most of the load serving entities in MISO are vertically integrated utilities operating under the Cost-of-Service model. The amount of profit a utility makes on capital assets is called the Rate of Return (RoR) on the Rate Base.
- For the purposes of our study, the assumed rate of return is 9.9 percent with debt/equity split of 48.92/51.08 based on the rate of return and debt/equity split of the ten-largest investor-owned utilities in MISO.

# Transmission

- This analysis assumes the transmission capacity on the MISO system will need to increase by 27,354 miles, constituting a 40 percent increase in the amount of transmission installed in MISO's U.S. footprint.
- According to MISO's Renewable Integration Impact Analysis (RIIA) study, most of the required increases in transmission capacity would occur in high voltage transmission lines, meaning those over 230 kilovolts (kV), with the largest increases needed for lines over 345 kV.
- MISO has approximately 68,000 circuit-miles of transferred functional control transmission lines serving as the backbone of the footprint in the United States, with approximately 10,409-line miles of 230 kV transmission lines, 12,435-line miles of 345 kV, 2,250-line miles of 500 kV, and 148-line miles of 765 kV.
- Line miles are estimated based on the author's best interpretation of Figure 1.1-4 in the Midcontinent Independent Systems Operator, "MISO Transmission Expansion Plan 2022," Accessed July 27, 2023, <https://cdn.misoenergy.org/MTEP22%20Chapter%201%20-%20MTEP%20Overview627346.pdf>.

# Transmission Continued

- In its Electricity Futures Study, the National Renewable Energy Laboratory suggests grids powered by 85 percent wind, solar, and battery storage resources will require additional transmission buildouts of 85.6 percent. This study increases the number of line miles for transmission lines of 230 kV and higher by 85.6 percent.
- This buildout of transmission lines is estimated to cost \$102.9 billion. Costs were calculated using the distance per mile costs from the 2021 Midcontinent Independent Systems Operator Transmission Cost Estimation Guide. We assume all transmission expenses are paid by MISO ratepayers.
- These transmission buildouts are consistent with, and more conservative than, the estimated transmission needs in the Net-Zero America study Reference Case, which suggests the nation will need to expand transmission capacity by 47 percent at a cost of \$954 billion.
- Interconnection costs were estimated to be approximately \$48,000 per MW of wind or solar installed, the average cost of active projects at the point of interconnect.
- National Renewable Energy Laboratory, “Renewable Electricity Futures Study: Executive Summary,” U.S Department of Energy, 2012, <https://www.nrel.gov/docs/fy13osti/52409-ES.pdf>.
- Midcontinent Independent Systems Operator, “Transmission Cost Estimation Guide for MTEP21,” April 27, 2021, <https://bit.ly/3AZu59l>.
- Andrew Pascale et al., “Princeton’s Net-Zero America study Annex F: Integrated Transmission Line Mapping and Costing,” Princeton University, August 1, 2021, <https://netzeroamerica.princeton.edu/img/NZA%20Annex%20F%20-%20HV%20Transmission.pdf>.
- Lawrence Berkeley Labs, “Data from MISO Show Rapidly Growing Interconnection Costs,” Electricity Markets and Policy, October 7, 2022, <https://emp.lbl.gov/news/data-miso-show-rapidly-growing>.

# Taxes and Subsidies

- Additional tax payments for utilities were calculated to be of 1.3 percent of the rate base.
- State income tax rate of 7.3 percent was estimated by averaging the states within the MISO region.
- Federal income tax rate is 21 percent.
- Production Tax Credit of \$27.50.
- Investment Tax Credit of 30 percent through 2032, 26 percent in 2033, and 22 percent in 2034.
- Coal 45-Q Subsidy of \$85 per ton CO<sub>2</sub> sequestered.

# Capital costs and Fixed and Variable Operations and Maintenance Costs

- Capital costs, for all new generating units are sourced from the EIA 2023 Assumptions to the Annual Energy Outlook (AOE) Electricity Market Module (EMM). These costs are held constant throughout the model run. Expenses for fixed and variable O&M for new resources were also obtained from the EMM. Capital costs were an average of the MISO regions, and national fixed and variable O&M costs were obtained from Table 3 in the EMM report.
- U.S. Energy Information Administration, “Electricity Market Module,” Assumptions to the Annual Energy Outlook 2023, March 2023, [Assumptions to the Annual Energy Outlook 2023: Electricity Market Module \(eia.gov\)](#)

# Unit Lifespans and Repowering

- Different power plant types have different useful lifespans. Our analysis takes these lifespans into account. Wind turbines are assumed to last for 20 years, solar panels are assumed to last 25 years, battery storage for 15 years.
- New natural gas plants are assumed to last for 30 years.
- Existing natural gas plants are presumed to be capable of continued operation throughout the model run.
- Our model assumes wind turbines, solar panels, and battery storage facilities are repowered after they reach the end of their useful lives. Our model also excludes economic repowering, a growing trend whereby wind turbines are repowered after just 10 to 12 years to recapture the wind Production Tax Credit (PTC). This trend will almost certainly grow in response to IRA subsidies.
- EPA does not appear to take repowering into consideration because the amount of existing wind on its systems never changes, and the capacity accreditations for existing wind remain constant. If our understanding of EPA's methodology is accurate, this a large oversight that must be corrected.

# Fuel Cost Assumptions

- Fuel costs for existing power facilities were estimated using FERC Form 1 filings and adjusted for current fuel prices. Fuel prices for new power plants were estimated using the most recent nuclear fuel cost data provided by EIA.
- **Natural gas fuel costs**
  - Existing natural gas prices were assumed to be \$23.00 per MWh and \$35.76 per MWh for CC and CT plants, respectively, based on data obtained from 2020 FERC Form 1 filings and adjusted for fuel prices used by EPA throughout the model.
- **Coal fuel costs**
  - Existing coal fuel cost assumptions of \$17.82 per MWh were based on 2020 FERC Form 1 filings for MISO coal plants.
- **Hydrogen fuel costs**
  - Fuel prices for green hydrogen are assumed to be \$5 per kilogram (kg) based on recent estimates from the U.S. Department of Energy. A \$3 per kg subsidy from the IRA is retroactively accounted applied to this these fuel expenditures.
  - An assumed cost of \$5 per kg is much higher than EPA's assumed cost of \$1 and \$0.50 per kg assumptions at various points throughout its model run. The agency does not offer a satisfactory explanation of why prices drop so dramatically.
  - One reason cited by EPA for falling prices are subsidies paid out as a result of the Inflation Reduction Act, but subsidies don't change how much a good or service costs; it simply shifts who pays for it.
  - The agency also fails to account for the cost of the massive hydrogen infrastructure that would be needed to use green hydrogen at scale, an enormous shortcoming in its analysis.
- <https://tradingeconomics.com/commodity/natural-gas>
- <https://data.nasdaq.com/data/EIA/COAL-us-coal-prices-by-region>
- <https://www.eia.gov/opa/v1/qb.php?category=40694&sdid=SEDS.NUEGD.WI.A>